



VIALLI GERMANY  **GmbH**

BUILDING THE FUTURE ONE PIPE AT A TIME

PP-Rc PIPES & FITTINGS

VIALLI GmbH München Germany

Pipes & Fittings

VIALLI, a renowned German brand specializing in plastic piping systems, is proudly manufactured by **VIALLI GmbH München Germany**. With over 15 years of experience, we have consistently delivered top-quality products utilizing cutting-edge German technology that adheres to DIN Standards, utilizing only the highest quality materials.

Our commitment to excellence extends beyond borders as we export our products to Europe, various parts of Asia, and the Middle East. Our overarching vision is to broaden our reach and make this exceptional product accessible to as many regions as possible.

Our comprehensive range of products includes:

VIALLI PP-Rc Pipes & Fittings, meticulously crafted in accordance with German DIN 8077 and DIN 8078 Standards. Our lineup includes PP-Rc Stabi pipes with an aluminum layer and PP-Rc Fiberglass Composite Pipes.

VIALLI PP-RCT Pipes & Fittings, similar to our standard PP-Rc offerings, our PP-RCT Pipes and Fittings meet the stringent requirements of German DIN 8077 and DIN 8078 Standards. This range also encompasses PP-Rc Stabi pipes with an aluminum layer and PP-Rc Fiberglass Composite Pipes.

VIALLI PEXa pipe & fittings products are engineered to meet the rigorous German standards of DIN 16892 and DIN 16893, ensuring the required Cross-link Degree for optimal performance.

At VIALLI, we prioritize the highest hygienic and quality standards. For more details and to explore our complete product catalogue, make sure to visit our website. Your satisfaction is our priority, and we look forward to serving you with excellence.

All of our products have undergone rigorous testing to ensure they meet the stringent Hygienic and Quality Test Requirements recommended by WRAS.



SYSTEM CHARACTERISTICS AND BENEFITS

1. Plastic piping for interior hot and cold water distribution systems in buildings, floor & Central Heating Systems.
2. Meeting all health requirements
3. No corrosion and / or encrustation
4. Exceptionally long service life while preserving high utility value
5. Trouble- Free operations with less noise
6. Less friction losses than with traditional materials
7. Less weight compared to traditional materials
8. Quick, easy and clean installation works
9. Resistance in aggressive environments.

ENVIRONMENTAL ASPECTS

Fully recyclable product; neither toxic nor otherwise harmful substances are used in its manufacture and/ or application.

INTENDED USE

It is intended for interior hot and cold water distribution systems in buildings and floor & central heating systems:

PN 10-cold water distribution and floor heating systems

PN 16-Higher Pressure cold water distribution and DHW Systems at lower Pressures

PN 20- Hot water distribution systems, Central Heating

PN 25- Hot water distribution systems, Central Heating

TECHNICAL SPECIFICATIONS

Material – statistical polypropylene copolymer (random – copolymer) for injection molding and extrusion processes with excellent welding ability; nickel – plated brass fittings

Manufacturing process – pipes are produced by extrusion, while fittings by injection molding

Shapes - pipe lengths 4 Meter

Assembly / Fixing – the product range covers all needs for interior water distribution systems and heating system routes

Transitions for other pipe material – implemented by threaded connection (i.e. by combined couplings) or flange connections.

Coupling – standard method is poly fusion welding or by electro fitting

Surface finish – elements are in green color without any finish, Separate metal element brass, alternatively, nickel plated, black identification printing on the surface.

PHYSIC CHEMICAL PROPERTIES

Density – 0.9 Kg/m³

Thermal expansion coefficient- for VIALLI PP-Rc pipes 0.15mm/Mk

Thermal conductivity - 0.22 W/Mk, fire rating –Class C3

Resistance against Chemicals – PP-Rc piping systems are intended mainly for water distribution (drinking, cold, hot, irrigation, etc.) – it is also possible to use the system for other media, in which in case their concrete use is governed by DIN 8078 Bb-1 possible to consult the manufacturer.

LABORATORY OPERATION & TEST DEVISSSES

1. MFI (Melt Flow Index) Test Device:

This device is used in simulating the material's flow behavior before being processed in the extruder. This device gives us information regarding the flow rate of the material in the unit temperature and time, this helps us to have information on the possible behavior of the material in the extruder. The quality Standard for this test is ISO 1133.

2. Precise Balance:

Using this balance, the weight of the material which was passed from MFI device is determined according to standard ISO 1183 separately in the air and in the liquid whose density is known. After having these weight figures, the material's density is determined by using the specific density formula.

3. IZOD-Charpy test Device:

With this device, the amount of the energy absorption and the possible applicable force on the unit area are determined by using free falling method using materials having different weights. By doing this test, we obtain information regarding material's behavior at the different loads with sudden impacts. The standards applied for this test are TS 1004, TS 1005, ISO 179 and ISO 180.

4. Pulling – Pressing Test Device:

Using this device, we obtain information's about the maximum load strength, elasticity module (the maximum force strength per unit area) maximum tension. Elongation in percentage, deformation, elongation at break point, tension at break point etc. of the product. By means of these test we can make forecasts on the possible behavior of the material in the working conditions. In these test ISO R 527 standard is applied.

5. Hallow Die Punch (sampling Device):

This device is used for the preparation of the sample which will be tested in the pulling test device. The sample is prepared in accordance with Standard No. ISO 527

6. Shore (Hardness Device):

This device is used to determine the material's Hardness. When we apply load on the sample, if the material is too soft then it will be pressed like paper, while if it is too hard then deformation will occur. For this reason, the hardness value of the product must be within the range of the values mention in the Standard No. DIN 53505.

7. Microtome Device:

This is a device used to cut small pieces which can be monitored under microscope for the purpose of inspecting the infrastructure of the material.

8. Microscope Image System:

This is a system used for monitoring the fibrous structure of the material. The aim of this test is to ensure that the material has a homogeneous infrastructure. If the fibrous image is not consistent, it indicates that there may be an issue either in the production stage or with the quality of the raw material itself.

9. Furnace-Deep Freezer:

These devices are used for rapid cooling or heating through shock testing. At specific intervals of time, an impact test is applied to the material held in the furnace or deep freezer, and its behavior is monitored at different test temperatures.

10. Furnace:

³ This device is used for thermal strength testing. The purpose of this test is to monitor whether the length of the material exceeds more than 3% when subjected to a specific temperature for a certain period. This test is important because at considerably higher temperatures, the material expands and elongates, while at lower temperatures, it contracts. However, after exposure to higher or lower temperatures, the material does not fully return to its normal size at normal temperatures. This characteristic leads to a change from a round shape to an oval shape in a closed pipe system. The standard applied for this test is TS 5450.

11. Pressure Test:

For the pipes produced according to the standard TS 5439, to monitor the strength of the pipes when subjected to pressure, a pressure test is administered under 100h (at 20 °C), and 165 and 1000h (at 80 °C). the standards used for this test are ISO 4427 (for PE 100), ISO 4437 (for 80) and TSE 10827.

12. Momentum Strength Test:

In addition to the leak test, a strength test is applied with the aim of testing the harmonically work of the metal fittings with plastic. In order to be able to apply a 95 °C temperature to the pipe it must resist 10 Bar pressure for short time test.

CERTIFICATES

Certificate No. 240355055
(PPR Single Layer)

www.wras.co.uk/directory



Certificate No. 240455058
(Aluminum Composite)

www.wras.co.uk/directory

Certificate No. 240455059
(Glass Fiber Composite)

www.wras.co.uk/directory



TECHNICAL SPECIFICATION

1. Mechanical Properties:

Property	Measuring Technique	Unit	Value
Coefficient of viscosity J. Average molar Weight	ISO 1191 Solvent viscosity C= 0.001 g/cm ³	Cm ³ /g	400
Melting index	ISO / R1133	g/10 min	0.5
MFI 190/5	Procedure 5	g/10 min	1.5
MFI 230/s	Procedure 14		
Density	SO/ R1183	g/cm ³	0.895
Melting range	Polarizing microscope	°C	140-150
Double voltage	ISO / R527	N/mm ²	21
Ultimate tensile strength	Char Speed D	N/mm ²	40
Expansion to at tear	Test bar Fig. 2	%	800
Ball – pressure Hardness	ISO 2039 (H 358/30)	N/mm ²	40
Bending stress at 3.5% Edge Fiber expansion	ISO 178 Test Specimen 5.1	N/mm ²	20
Modulus of elasticity	ISO 178	N/mm ²	800
Modulus of transverse elasticity		N/mm ²	1,100
-10° C		N/mm ²	770
0° C		N/mm ²	500
10° C	ISO / R537	N/mm ²	370
20° C	Method A	N/mm ²	300
30° C		N/mm ²	240
40° C		N/mm ²	180
50° C		N/mm ²	140
60° C		N/mm ²	
Tensile properties further to impact bending test at 0°C	DIN 8078		No Fracture
Impact Strength (according to Charpy) RT	ISO /R179	mJ/mm ²	No Fracture
0°C	Test bar in conformity with fig. 2	mJ/mm ²	No Fracture
-10°C		mJ/mm ²	No Fracture

TECHNICAL SPECIFICATION

Allowable operating pressure for PP-Rc pipes conveying water, safety factor (SF) = 1.5

Temperature °C	Years of Service	Standard dimension ratio SDR		
		9	7.4	6
10	1	22.1	27.8	35.1
	5	20.8	26.2	33.0
	10	20.3	25.6	32.2
	25	19.6	24.7	31.1
	50	19.1	24.1	30.3
	100	18.5	23.5	29.6
20	1	18.8	23.7	29.9
	5	17.7	22.3	28.1
	10	17.2	21.7	27.4
	25	16.6	21.0	26.4
	50	16.2	20.4	25.7
	100	15.8	19.9	25.0
30	1	16.0	20.2	25.4
	5	15.0	18.9	23.8
	10	14.6	18.4	23.2
	25	14.1	17.7	22.3
	50	13.7	17.2	21.7
	100	13.3	16.8	21.1
40	1	13.6	17.1	21.6
	5	12.7	16.0	20.2
	10	12.3	15.5	19.6
	25	11.9	15.0	18.8
	50	11.5	14.5	18.3
	100	11.2	14.1	17.8
50	1	11.5	14.5	18.2
	5	10.7	13.5	17.0
	10	10.4	13.1	16.5
	25	10.0	12.6	15.9
	50	9.7	12.2	15.4
	100	9.4	11.8	14.9
60	1	9.7	12.2	15.4
	5	9.0	11.3	14.3
	10	8.7	11.0	13.9
	25	8.4	10.5	13.3
	50	8.1	10.2	12.9
	100	7.8	9.9	12.6
70	1	8.1	10.3	12.9
	5	7.5	9.5	12.0
	10	7.3	9.2	11.6
	25	6.3	8.0	10.0
	50	5.3	6.7	8.5
	100	4.8	6.1	7.6
80	1	6.8	8.6	10.8
	5	6.0	7.6	9.6
	10	5.1	6.4	8.1
	25	4.1	5.1	6.5
95	1	4.8	6.1	7.6
	5	3.2	4.1	5.2
	(10) ^a	(2.7)	(3.4)	(4.3)

Consistency Properties

Consistency Properties PN 20

From the requirements of the temperature/pressure ratio in accordance with DIN 1988 T2 and the long term durability properties in accordance with DIN 16962 and DVS 2207, the Green pipes with a pressure degree PN20 meets the specified safety correction value of Safety Factor = 1.5

in accordance with DIN 1988 T2, the following requirements are stipulated as regards service on drinking water pipe systems.

Table 2: shows the admissible operation pressure depending on the temperature with a maximum number of years of operation for the transfer of water.

	Operational Excess pressure bar	Temp °C	Hours p.a h
Cold water	0 to 10 Fluctuating	To 25	8760
Hot Water	0 to 10 Fluctuating	Up 60 Up to 85	8760 50

Table 1: operation requirements for pipes

Temp. (°C)	Max. OP. (years)	Adm. Pressure
10	50	29.3
20	50	25.9
30	50	22.1
40	50	18.4
50	50	14.7
60	50	10.9
70	50	8.0
80	50	6.5
95	50	5.2

Table2:Admissible operational pressure

Consistency properties PN25

With regard to the demands of the temperature/pressure ratio in accordance with DIN 1988 T2 and long-term durability properties in accordance with DIN 16962 & DVS 2207. The VIALLI pipe with pressure degree PN25 meets the specified safety correction value of safety Factor=1.5

Table 4: demonstrates the admissible operation pressure depending on the temperature for the flow media, taking into account a maximum number of years of operation.


	Operational Excess pressure bar	Temp °C	Hours p.a h
Cold water	0 to 10 Fluctuating	To 25	8760
Hot Water	0 to 10 Fluctuating	Up 60 Up to 85	8030 730

Table 3: Operation requirements for pipes

Temp. (°C)	Max. OP. (years)	Adm. Pressure
10	50	36.7
20	50	32.3
30	50	27.7
40	50	23.0
50	50	18.3
60	50	13.7
70	50	10.0
80	50	8.1
95	50	6.5

Table4:Admissible operational pressure

Behavior Under Long Term Stress

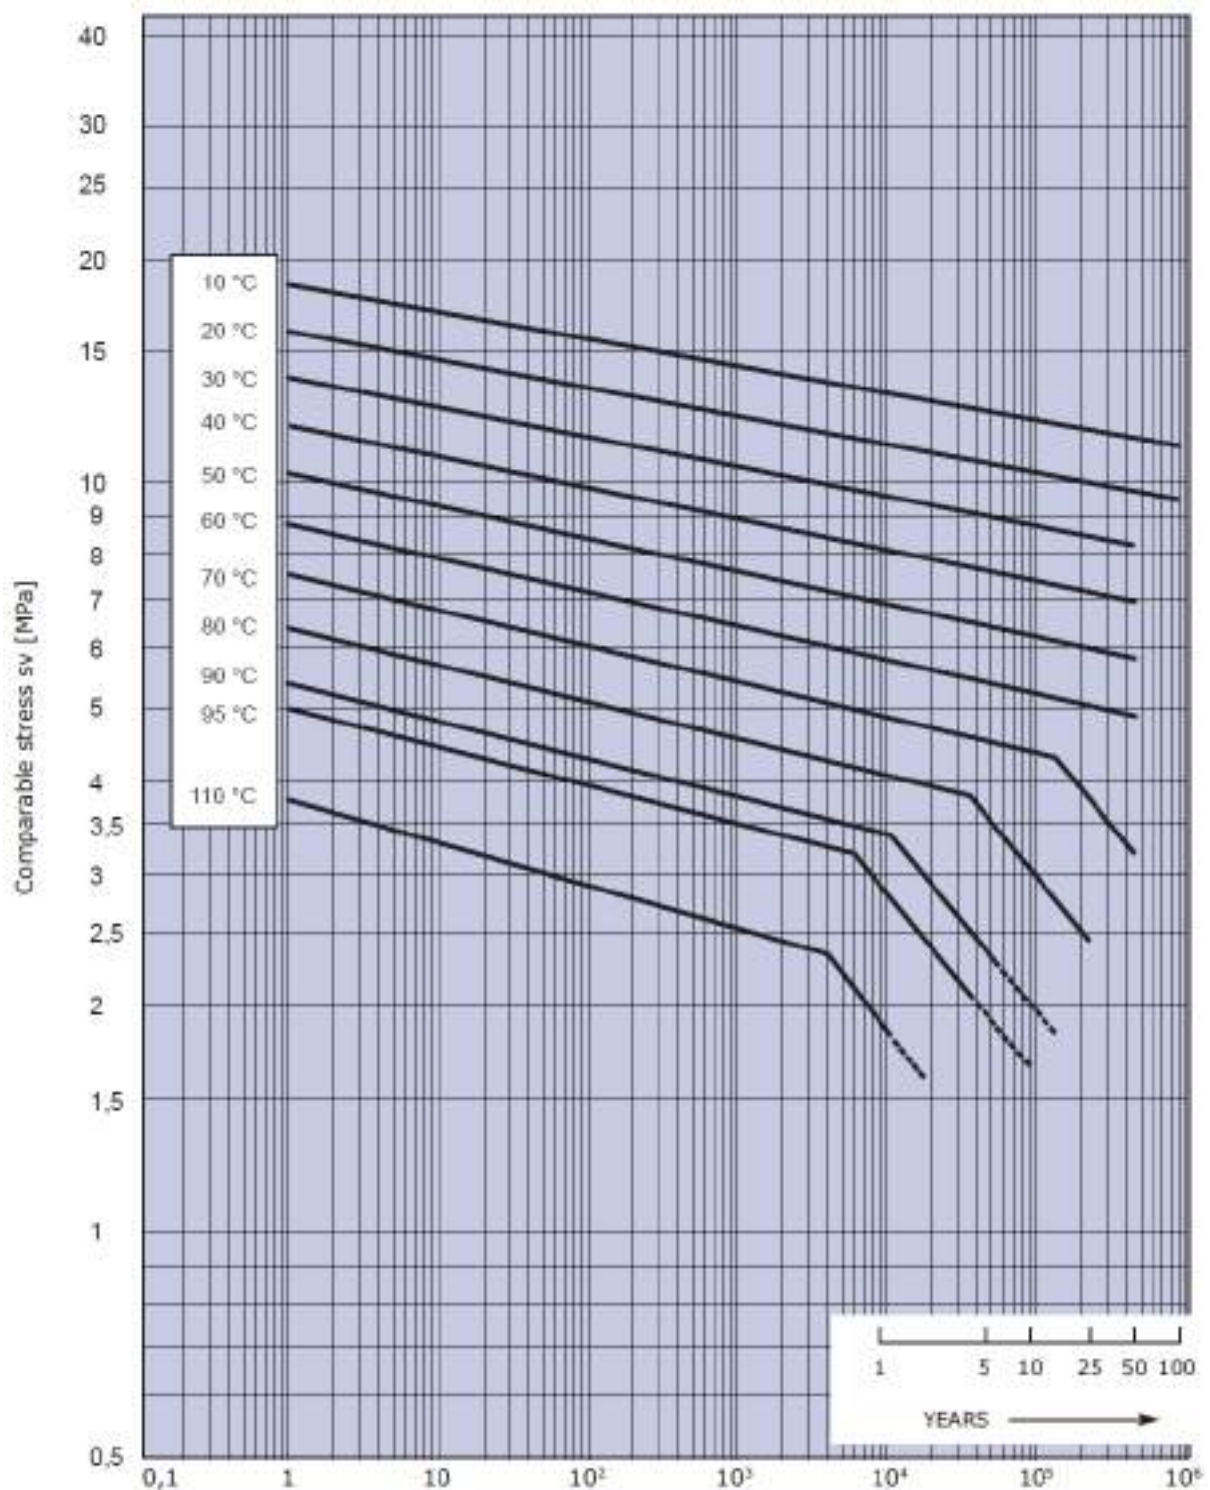

Service Life in Hours

Termination of an isotherm indicates maximum service life also at lower tension.

Linear expansion

The following items need to be taken into consideration when calculating modifications in length

- ❖ Ambient and materials temperature upon installation
- ❖ Temperature difference between lowest and highest pipe wall temperatures
- ❖ Expansion coefficient

Below the formula for the calculation of length alteration:

$$\Delta L = \alpha \times L \times \Delta T$$

The alteration of length may be compensated by means of extensions loops, bending e.g. extension bows or appropriate adapters.

FP = Fixing Point

LS = length of bending Pipe

SP = Sliding Point

$$\Delta L = \Delta L_1 + \Delta L_2$$

The minimum length of the bending leg results from:

$$L = K \cdot \sqrt{d \cdot \Delta L}$$

Expansion:


L = length of bending leg in mm

K = Constant depending on material
(K value for PP = 15)

d = pipe diameter in mm

Δ = elongation in mm calculated by equation $\Delta L = \alpha \cdot L \cdot \Delta T$

Example of graphic and mathematical determination of bending

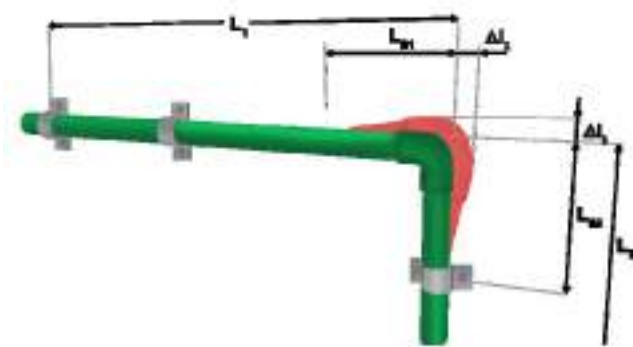

Expansion

ΔL = length alteration in mm

α = Expansion coefficient in K^{-1}

polypropylene pipes $\alpha = 0.15$

prostab AL/PPR composite

pipes $\alpha = 0.05$


L = pipe length in mm


ΔT = Difference in temperature in K

Example

Pipe length	Temperature range	
	Free wall temperature	60 °C
Temperature at installation	15 °C	
Difference in temp.	45K	

$$\Delta L_2 = 0.15 \cdot 6.45 = 40.5 \text{ mm}$$

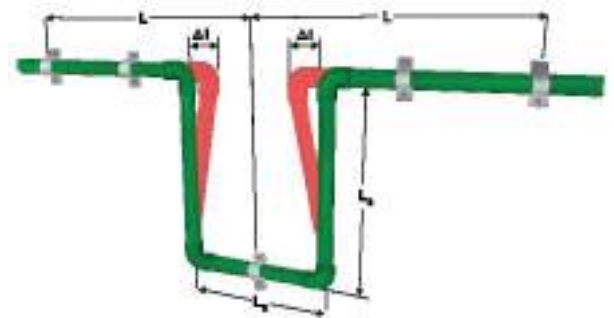

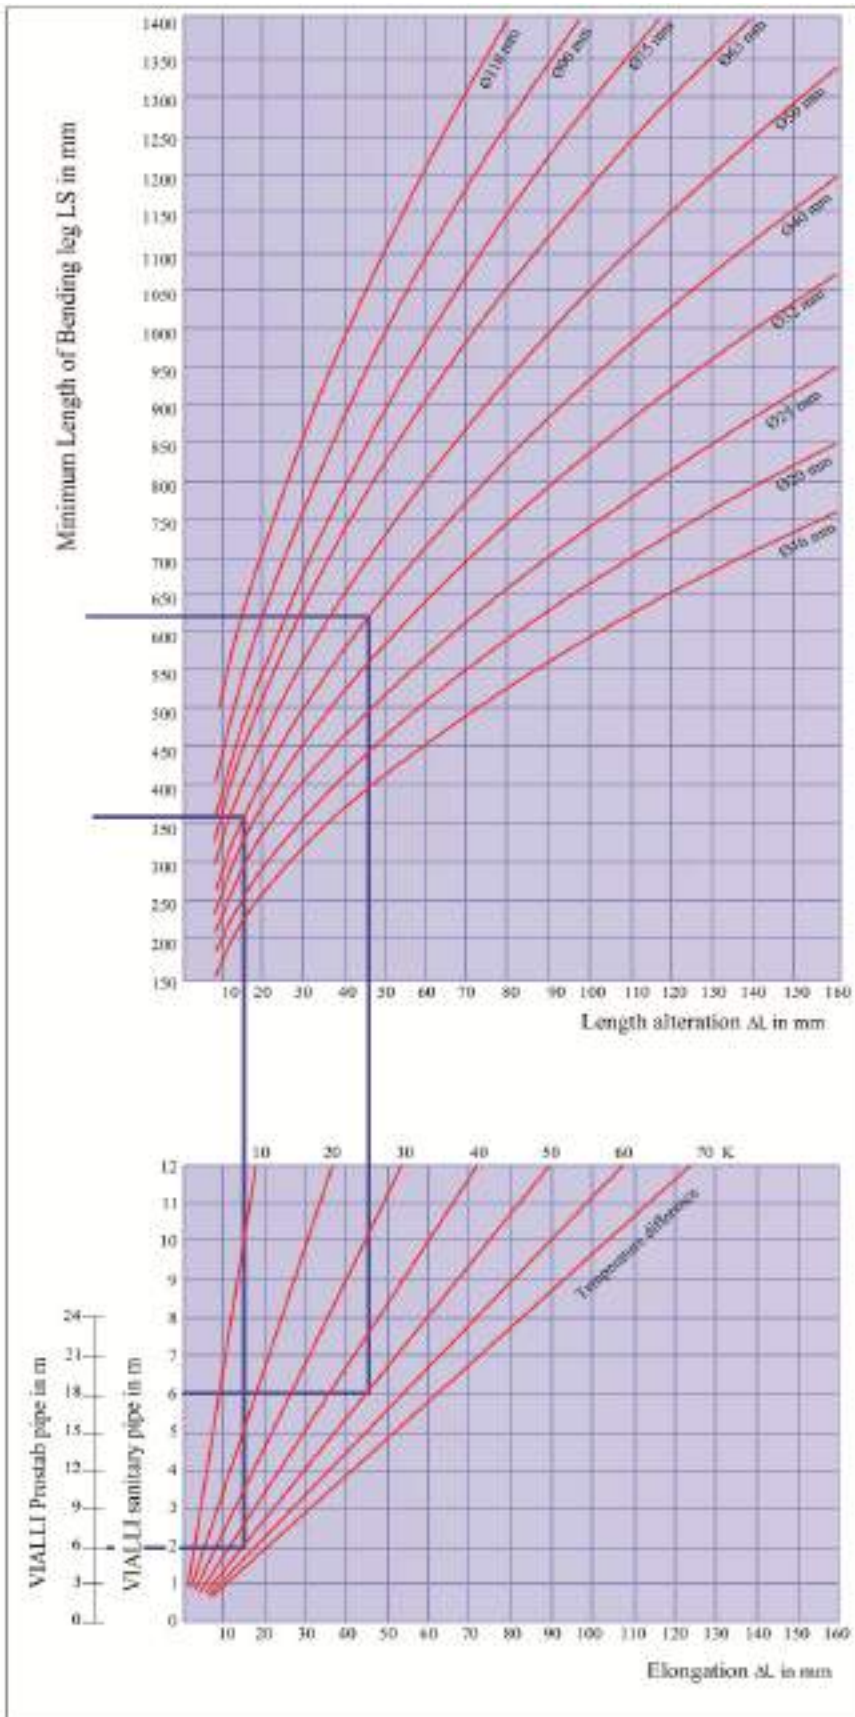

Example 1

To be Established:
 Minimum bending leg for a VIALLI pipe
 Ø=40, pipe Length 6m,
 ΔT= 50 K

1. Expansion
 $\Delta L = 0.15 \times 6 \times 50 = 45 \text{ mm}$
2. Minimum bending Leg Length:
 $L_S = 15 \sqrt{40 \times 45} = 636 \text{ mm}$

Example 2

To be Established:
 Minimum bending leg for a VIALLI pipe

1. Expansion
 $\Delta L = 0.05 \times 5 \times 50 = 15 \text{ mm}$
2. Minimum bending Leg Length:
 $L_S = 15 \sqrt{40 \times 15} = 367 \text{ mm}$

4. Bearing Distance / Fixed reference point Version

Bearing Distance

Arrangement of Fix points for Horizontal piping
 Bearing Distance for VIALLI pipe to PN20 – PN25

Temp. °C	External Diameter pipe mm									
	16	20	25	32	40	50	63	75	90	110
Fixing intervals cm										
0	70	85	105	125	140	165	190	205	220	225
20	50	60	75	90	100	120	140	160	160	220
30	50	60	75	90	100	120	140	150	160	215
40	50	60	70	80	90	110	130	140	150	210
50	50	60	70	80	90	110	130	140	150	200
60	50	55	65	75	85	100	115	125	140	180
70	50	50	60	70	85	95	105	115	125	175

Bearing Distance VIALLI prostab pipe

Temp. °C	External Diameter pipe mm								
	16	20	25	32	40	50	63	75	90
Fixing intervals cm									
0	130	155	170	195	220	245	270	285	300
20	100	120	130	150	170	190	210	220	230
30	100	120	130	150	170	190	210	220	230
40	100	110	120	130	160	180	200	210	230
50	100	110	120	140	160	180	200	210	220
60	80	100	110	130	150	170	190	200	210
70	70	90	100	120	140	160	180	190	200

Fixed Point Version

A fix point is established by welding sleeves or other molded parts on either side of the pipe clip. Fixed points to be arrange in a line need to be so selected that alterations in direction in the pipe route are exploited.



Drop in pressure Owing to pipe Friction

Pressure drops owing to pipe friction and calculated flow speed depending on peak flow for all pipes of the VIALLI installation system

Following charts of pressure drops resulting from pipe friction were established in analogy to DIN 1988, Section 3

Starting Values:

- ❖ Reference Temperature 10°C
- ❖ Reference pressure 10 bar
- ❖ Absolute roughness of interior pipe wall $K = 0.007$ mm
Calculation of pipe friction coefficient according to Colebrook White)

Note:

Pressure losses resulting from pipe friction change only insignificantly in the operating temperature range (up to 60°C) of Domestic Cold & Hot water supply system, therefore it is customary for the house installation to calculate with an overall supply pipes reference temperature of 10 °C (DIN 1988)

The Legal unit used (SI unit) for pressure is the Pa (Pascal) Value, However, DIN standards refers to bar unit or mbar, respectively. Should the loss in pressure required in practice be the Pascal Value, the Following ratio will apply: 1 mbar = 100 Pa.

Intermediate values not indicated in the tables may be interring polated. It should be noted, however, that no liner functions serve as basis

Losses in pressure of the Prostab pipes may be seen from the tables of nominal pressure degree PN20 & PN25 as the inner pipes have the same Dimensions.

Pressure drops owing to pipe friction (R) and calculated flow Speed (V) depending on peak flow (V_s)

Polypropylene pipes

Type3 in acc. With DIN 8077, nominal pressure Degree PN16

Peak Flow Vs L/s	DN 10 d _a = 16mm d _i = 11.6mm		DN 12 d _a = 20mm d _i = 14.4mm		DN 16 d _a = 25mm d _i = 18.0mm	
	R mbar/m	V m/s	R mbar/m	V m/s	R mbar/m	V m/s
0.01	0.18	0.09	0.04	0.06	0.02	0.04
0.02	0.59	0.19	0.21	0.12	0.07	0.08
0.03	1.19	0.28	0.42	0.18	0.15	0.12
0.04	1.96	0.38	0.70	0.25	0.24	0.16
0.05	2.90	0.47	1.03	0.31	0.36	0.20
0.06	4.01	0.57	1.42	0.37	0.49	0.24
0.07	5.27	0.66	1.86	0.43	0.64	0.28
0.08	6.68	0.76	2.36	0.49	0.81	0.31
0.09	8.25	0.85	2.91	0.55	1.00	0.35
0.10	9.97	0.95	3.51	0.61	1.20	0.39
0.12	13.85	1.14	4.86	0.74	1.66	0.47
0.14	18.31	1.32	6.40	0.86	2.18	0.55
0.16	23.34	1.51	8.14	0.98	2.77	0.63
0.18	28.93	1.70	10.07	1.11	3.42	0.71
0.20	35.09	1.89	12.19	1.23	4.13	0.79
0.30	74.18	2.84	25.55	1.84	8.58	1.18
0.40	126.91	3.78	43.42	2.46	14.50	1.57
0.50	193.69	4.73	65.73	3.07	21.84	1.96
0.60	273.37	5.68	92.42	3.68	30.59	2.36
0.70	366.39	6.62	123.47	4.30	40.72	2.75
0.80	472.71	7.57	159.33	4.91	52.23	3.14
0.90	592.31	8.52	199.09	5.53	65.10	3.54
1.00	725.17	9.46	243.16	6.14	79.34	3.93
1.20	1030.66	11.35	344.20	7.37	112.23	4.72
1.40	1389.12	13.25	462.41	8.60	150.22	5.50
1.60	1800.52	15.14	597.75	9.82	193.59	6.29
1.80	2264.83	17.03	750.22	11.05	242.32	7.07
2.00	2782.05	18.92	919.80	12.28	296.41	7.86
2.20	3352.17	20.82	1106.49	13.51	355.85	8.65
2.40	3875.17	22.71	1310.27	14.74	420.64	9.43
2.60	4651.06	24.60	1531.15	15.96	490.77	10.22
2.80	5379.84	26.49	1769.13	17.9	566.24	11.00
3.00	6161.49	29.39	2024.19	18.42	647.05	11.79
3.20	6996.02	30.28	2296.33	19.65	733.20	12.58
3.40	7883.42	32.17	2585.57	20.88	824.68	13.36
3.60	8823.70	34.06	2891.88	22.10	921.50	14.15
3.80	9816.85	35.96	3215.28	23.33	1023.65	14.93
4.00			3555.76	24.56	1131.13	15.72
4.20			3913.33	25.79	1243.94	16.50
4.40			4287.97	27.02	1362.08	17.29
4.60			4679.70	28.25	1485.56	18.08
4.80			5088.50	29.47	1614.36	18.86
5.00			5514.38	30.70	1748.49	19.65
5.20			5957.35	31.93	1887.95	20.43
5.40			6417.39	33.16	2023.75	21.22
5.60			6894.51	34.39	2182.87	22.01
5.80			7388.70	35.61	2338.31	22.79
6.00			7899.98	36.84	2499.09	23.58
6.20			8428.34	38.07	2664.19	24.36
6.40			8973.77	39.30	2836.63	25.15
6.60			9536.28	40.53	3013.39	25.94
6.80					3195.48	26.72
7.00					3382.89	27.51
7.50					3874.74	29.47
8.00					4399.89	31.44
9.00					5550.06	35.37
10.00					6833.41	39.30

Pressure drops owing to pipe friction (R) and calculated flow Speed (V) depending on peak flow (V_s)

Polypropylene pipes

Type3 in acc. With DIN 8077, nominal pressure Degree PN16

Peak Flow	DN 20 d _a = 32mm d _i = 23.0mm		DN 25 d _a = 40mm d _i = 28.8mm		DN 32 d _a = 50mm d _i = 36.2mm	
	V _s L/s	R mbar/m	V m/s	R mbar/m	V m/s	R mbar/m
0.01	0.01	0.02	0.00	0.02	0.00	0.01
0.02	0.02	0.05	0.01	0.03	0.00	0.02
0.03	0.05	0.07	0.02	0.05	0.00	0.03
0.04	0.08	0.10	0.03	0.06	0.01	0.04
0.05	0.11	0.12	0.04	0.08	0.01	0.05
0.06	0.15	0.14	0.05	0.09	0.02	0.06
0.07	0.20	0.17	0.07	0.11	0.02	0.07
0.08	0.25	0.19	0.09	0.12	0.03	0.08
0.09	0.31	0.22	0.11	0.14	0.04	0.09
0.10	0.37	0.24	0.13	0.15	0.04	0.10
0.12	0.51	0.29	0.18	0.18	0.06	0.12
0.14	0.67	0.34	0.23	0.21	0.08	0.14
0.16	0.85	0.39	0.29	0.25	0.10	0.16
0.18	1.05	0.43	0.36	0.28	0.12	0.17
0.20	1.27	0.48	0.43	0.31	0.14	0.19
0.30	2.61	0.72	0.88	0.46	0.30	0.29
0.40	4.39	0.96	1.48	0.61	0.49	0.39
0.50	6.58	1.20	2.21	0.77	0.73	0.49
0.60	9.18	1.44	3.07	0.92	1.02	0.58
0.70	12.18	1.68	4.06	1.07	1.34	0.68
0.80	15.58	1.93	5.18	1.23	1.71	0.78
0.90	19.36	2.17	6.43	1.38	2.11	0.87
1.00	23.53	2.41	7.80	1.54	2.56	0.97
1.20	33.04	2.89	10.91	1.84	3.57	1.17
1.40	44.07	3.37	14.50	2.15	4.73	1.36
1.60	56.62	3.85	18.57	2.46	6.04	1.55
1.80	70.93	4.33	23.13	2.76	7.50	1.75
2.00	86.53	4.81	28.16	3.07	9.11	1.94
2.20	103.63	5.30	33.66	3.38	10.87	2.14
2.40	122.22	5.78	39.63	3.68	12.78	2.33
2.60	142.32	6.26	46.07	3.99	14.83	2.53
2.80	163.91	6.74	53.17	4.30	17.02	2.72
3.00	186.99	7.22	60.56	4.61	19.36	2.91
3.20	211.56	7.70	68.42	4.91	21.85	3.11
3.40	237.63	8.18	76.74	5.22	24.48	3.30
3.60	265.18	8.66	85.53	5.53	27.25	3.50
3.80	294.23	9.15	94.78	5.83	30.17	3.69
4.00	324.76	9.36	104.50	6.14	33.23	3.89
4.20	356.78	10.11	114.67	6.45	36.57	4.08
4.40	390.29	10.59	125.32	6.75	39.91	4.28
4.60	425.28	11.07	136.42	7.06	43.41	4.47
4.80	461.77	11.55	147.99	7.37	47.04	4.66
5.00	499.73	12.03	160.01	7.68	50.82	4.86
5.20	539.19	12.52	172.50	7.98	54.73	5.05
5.40	580.13	13.00	185.46	8.29	58.79	5.25
5.60	622.55	13.48	198.87	8.60	62.99	5.44
5.80	666.46	13.96	212.75	8.90	67.33	5.64
6.00	711.86	14.44	227.08	9.21	71.81	5.83
6.20	758.74	14.92	241.88	9.52	76.44	6.02
6.40	807.11	15.40	257.14	9.82	81.20	6.22
6.60	856.96	15.89	272.86	10.13	86.11	6.41
6.80	908.29	16.37	289.04	10.44	91.15	6.61
7.00	961.11	16.85	305.68	10.75	96.34	6.80
7.50	1099.66	18.05	349.30	11.51	109.92	7.29
8.00	1247.48	19.26	395.80	12.28	124.38	7.77
9.00	1570.95	21.66	497.44	13.82	155.94	8.74
10.00	1931.52	24.07	610.57	15.35	191.01	9.72

Pressure drops owing to pipe friction (R) and calculated flow Speed (V) depending on peak flow (V_s)

Polypropylene pipes

Type3 in acc. With DIN 8077, nominal pressure Degree PN16

Peak Flow	DN 40 d _s = 63mm d _i = 45.6mm		DN 50 d _s = 75mm d _i = 54.2mm		DN 60 d _s = 90mm d _i = 65.0mm		DN 90 d _s = 110mm d _i = 79.6mm		
	V _s L/s	R mbar/m	V m/s	R mbar/m	V m/s	R mbar/m	V m/s	R mbar/m	V m/s
0.01	0.00	0.01	0.00	0.00	0.00	0.00	0.00	0.00	0.00
0.02	0.00	0.01	0.00	0.01	0.00	0.01	0.00	0.00	0.00
0.03	0.00	0.02	0.00	0.01	0.00	0.01	0.00	0.00	0.00
0.04	0.00	0.02	0.00	0.02	0.00	0.01	0.00	0.00	0.00
0.05	0.00	0.03	0.00	0.05	0.00	0.02	0.00	0.00	0.00
0.06	0.01	0.04	0.00	0.03	0.00	0.02	0.00	0.00	0.00
0.07	0.01	0.04	0.00	0.03	0.00	0.02	0.00	0.00	0.00
0.08	0.01	0.05	0.00	0.03	0.00	0.02	0.00	0.00	0.00
0.09	0.01	0.06	0.01	0.04	0.00	0.03	0.00	0.00	0.00
0.10	0.01	0.06	0.01	0.04	0.00	0.03	0.00	0.00	0.00
0.12	0.02	0.07	0.01	0.05	0.00	0.04	0.00	0.00	0.00
0.14	0.03	0.09	0.01	0.06	0.00	0.04	0.00	0.00	0.00
0.16	0.03	0.10	0.01	0.07	0.01	0.05	0.00	0.00	0.00
0.18	0.04	0.11	0.02	0.08	0.01	0.05	0.00	0.00	0.00
0.20	0.05	0.12	0.02	0.09	0.01	0.06	0.00	0.00	0.00
0.30	0.10	0.18	0.04	0.13	0.02	0.09	0.01	0.01	0.06
0.40	0.16	0.24	0.07	0.17	0.03	0.12	0.01	0.01	0.08
0.50	0.24	0.31	0.11	0.22	0.04	0.15	0.02	0.01	0.10
0.60	0.33	0.37	0.15	0.26	0.06	0.18	0.02	0.01	0.12
0.70	0.44	0.43	0.19	0.30	0.08	0.21	0.03	0.01	0.14
0.80	0.56	0.49	0.24	0.35	0.10	0.24	0.04	0.01	0.16
0.90	0.69	0.55	0.30	0.39	0.13	0.27	0.05	0.01	0.18
1.00	0.84	0.61	0.36	0.43	0.15	0.30	0.06	0.01	0.20
1.20	1.16	0.73	0.50	0.52	0.21	0.36	0.08	0.01	0.24
1.40	1.54	0.86	0.67	0.61	0.28	0.42	0.10	0.01	0.28
1.60	1.96	0.98	0.85	0.69	0.35	0.48	0.13	0.01	0.32
1.80	2.43	1.10	1.05	0.78	0.44	0.54	0.16	0.01	0.36
2.00	2.94	1.22	1.27	0.87	0.53	0.60	0.20	0.01	0.40
2.20	3.51	1.35	1.51	0.95	0.63	0.66	0.24	0.01	0.44
2.40	4.11	1.47	1.77	1.04	0.73	0.72	0.28	0.01	0.48
2.60	4.77	1.59	2.05	1.13	0.85	0.78	0.32	0.01	0.52
2.80	5.47	1.71	2.35	1.21	0.97	0.84	0.36	0.01	0.56
3.00	6.21	1.84	2.67	1.30	1.10	0.90	0.41	0.01	0.60
3.20	7.00	1.96	3.00	1.39	1.24	0.96	0.46	0.01	0.64
3.40	7.83	2.08	3.35	1.47	1.38	1.02	0.52	0.01	0.68
3.60	8.70	2.20	3.73	1.56	1.54	1.08	0.57	0.01	0.72
3.80	9.62	2.33	4.12	1.65	1.69	1.15	0.63	0.01	0.76
4.00	10.59	2.45	4.53	1.73	1.86	1.21	0.69	0.01	0.80
4.20	11.60	2.57	4.96	1.82	2.04	1.27	0.76	0.01	0.84
4.40	12.56	2.69	5.40	1.91	2.22	1.33	0.83	0.01	0.88
4.60	13.74	2.82	5.86	1.99	2.41	1.39	0.90	0.01	0.92
4.80	14.88	2.94	6.35	2.08	2.60	1.45	0.97	0.01	0.96
5.00	16.06	3.06	6.85	2.17	2.81	1.51	1.04	0.01	1.00
5.20	17.29	3.18	7.36	2.25	3.02	1.57	1.12	0.01	1.04
5.40	18.56	3.31	7.90	2.34	3.24	1.63	1.20	0.01	1.08
5.60	19.87	3.43	8.45	2.43	3.46	1.69	1.29	0.01	1.12
5.80	21.23	3.55	9.03	2.51	3.69	1.75	1.37	0.01	1.16
6.00	22.62	3.67	9.61	2.60	3.93	1.81	1.46	0.01	1.20
6.20	24.16	3.80	10.22	2.69	4.18	1.87	1.55	0.01	1.24
6.40	25.65	3.92	10.85	2.77	4.43	1.93	1.64	0.01	1.28
6.60	27.18	4.04	11.49	2.86	4.69	1.99	1.74	0.01	1.32
6.80	28.75	4.16	12.15	2.95	4.96	2.05	1.84	0.01	1.36
7.00	30.37	4.29	12.83	3.03	5.23	2.11	1.94	0.01	1.40
7.50	34.60	4.59	14.60	3.25	5.95	2.26	2.20	0.01	1.51
8.00	39.09	4.90	16.48	3.47	6.71	2.41	2.48	0.01	1.61
9.00	48.88	5.51	20.66	3.90	8.36	2.71	3.08	0.01	1.81
10.00	59.73	6.12	25.30	4.33	10.91	3.01	3.75	0.01	2.01

Pressure drops owing to pipe friction (R) and calculated flow Speed (V) depending on peak flow (V_s)

Polypropylene pipes

Type3 in acc. With DIN 8077, nominal pressure Degree PN20

Peak Flow	DN 10 d _a = 16mm d _i = 10.6mm v = 0.088 l/m		DN 12 d _a = 20mm d _i = 13.2mm v = 0.137 l/m		DN 16 d _a = 25mm d _i = 16.6mm v = 0.216 l/m	
	V _s L/s	R mbar/m	V m/s	R mbar/m	V m/s	R mbar/m
0.01	0.39	0.11	0.14	0.07	0.05	0.05
0.02	1.23	0.23	0.44	0.15	0.15	0.09
0.03	2.44	0.34	0.87	0.22	0.30	0.14
0.04	3.98	0.45	1.41	0.29	0.48	0.18
0.05	5.84	0.57	2.07	0.37	0.70	0.23
0.06	8.00	0.68	2.83	0.44	0.96	0.28
0.07	10.47	0.79	3.69	0.51	1.25	0.32
0.08	13.22	0.91	4.65	0.58	1.57	0.37
0.09	16.24	1.02	5.70	0.66	1.92	0.42
0.10	19.50	1.13	6.86	0.73	2.30	0.46
0.15	39.92	1.70	13.92	1.10	4.66	0.69
0.20	66.61	2.27	23.13	1.46	7.72	0.92
0.25	99.54	2.83	34.38	1.83	11.45	1.16
0.30	138.44	3.40	47.68	2.19	15.80	1.39
0.35	183.23	3.97	62.92	2.56	20.79	1.62
0.40	223.51	4.53	79.92	2.92	26.33	1.85
0.45	289.41	5.10	33.10	3.29	32.55	2.08
0.50	351.24	5.67	119.82	3.65	39.38	2.31
0.55			142.53	4.02	46.68	2.54
0.60			167.44	4.38	54.62	2.77
0.65			193.092	4.75	72.14	3.00
0.70			21.96	5.12	82.09	3.23
0.75			251.39	5.48	92.17	3.47
0.80					103.12	3.70
0.85					114.05	3.93
0.90					125.91	4.16
0.95					138.87	4.39
1.00					151.69	4.62
1.05					164.92	4.85
1.10					179.41	5.08
1.15					193.50	5.31
1.20						5.54

Pressure drops owing to pipe friction (R) and calculated flow Speed (V) depending on peak flow (V_s)

Polypropylene pipes

Type3 in acc. With DIN 8077, nominal pressure Degree PN20

Peak Flow	DN 20 d _a = 32mm d _i = 21.2mm v = 0.352 l/m		DN 25 d _a = 40mm d _i = 26.6 mm v = 0.556 l/m		DN 32 d _a = 50mm d _i = 33.2mm v = 0.866 l/m	
	V _s L/s	R mbar/m	V m/s	R mbar/m	V m/s	R mbar/m
0.05	0.22	0.14	0.08	0.09	0.03	0.06
0.10	0.72	0.28	0.25	0.18	0.09	0.12
0.15	1.46	0.42	0.50	0.27	0.17	0.17
0.20	2.40	0.57	0.82	0.36	0.29	0.23
0.25	3.55	0.71	1.21	0.45	0.42	0.29
0.30	4.89	0.85	1.65	0.54	0.58	0.35
0.35	6.42	0.99	2.17	0.63	0.76	0.40
0.40	8.15	1.13	2.75	0.72	0.95	0.46
0.45	10.04	1.27	3.38	0.81	1.17	0.52
0.50	12.11	1.42	4.06	0.90	1.41	0.58
0.60	16.76	1.70	5.63	1.08	1.95	0.69
0.70	22.07	1.98	7.40	1.26	2.55	0.81
0.80	28.10	2.27	9.39	1.44	3.24	0.92
0.90	34.64	2.55	11.58	1.62	3.99	1.04
1.00	42.01	2.83	14.00	1.80	4.82	1.16
1.10	49.92	3.12	16.64	1.98	5.71	1.27
1.20	58.59	3.40	19.45	2.16	6.65	1.39
1.30	67.80	3.68	22.42	2.34	7.71	1.50
1.40	77.52	3.97	25.64	2.52	8.78	1.63
1.50	88.14	4.25	29.16	2.70	9.95	1.73
1.60	98.83	4.53	32.72	2.88	11.16	1.85
1.70	110.48	4.82	36.58	3.06	12.48	1.96
1.80	122.63	5.10	40.62	3.24	13.80	2.08
1.90	135.95	5.38	44.82	3.42	15.23	2.19
2.00			49.17	3.64	16.72	2.31
2.10			53.67	3.78	18.25	2.43
2.20			58.61	3.96	19.84	2.54
2.30			63.42	4.14	21.58	2.66
2.40			68.70	4.32	23.26	2.77
2.50			73.70	4.50	25.11	2.89
2.60			79.40	4.68	26.89	3.00
2.70			85.18	4.86	28.85	3.12
2.80			91.13	5.04	30.87	3.23
2.90			97.24	5.22	32.78	3.35
3.00			103.51	5.40	34.90	3.47
3.10					37.07	3.58
3.20					39.30	3.70
3.30					41.57	3.81
3.40					43.90	3.93
3.50					46.27	4.04
3.60					48.95	4.16
3.70					51.43	4.27
3.80					53.96	4.39
3.90					56.53	4.51
4.00					59.15	4.62
4.10					62.14	4.74
4.20					64.86	4.85
4.30					67.61	4.97
4.40					70.79	5.08
4.50					73.64	5.20

Pressure drops owing to pipe friction (R) and calculated flow Speed (V) depending on peak flow (V_s)

Polypropylene pipes

Type3 in acc. With DIN 8077, nominal pressure Degree PN20

Peak Flow	DN 40 d _a = 63mm d _i = 42.0mm v = 1.385 l/m		DN 50 d _a = 75mm d _i = 50.0mm v = 1.963 l/m		DN 60 d _a = 90mm d _i = 60.0mm v = 2.827 l/m		DN 90 d _a = 110mm d _i = 73.2mm v = 4.200 l/m	
	V _s L/s	R mbar/m	V m/s	R mbar/m	V m/s	R mbar/m	V m/s	R mbar/m
0.25	0.03	0.07	0.01	0.05	0.01	0.04	0.01	0.06
0.50	0.09	0.14	0.04	0.10	0.02	0.07	0.03	0.12
0.75	0.19	0.22	0.08	0.15	0.04	0.11	0.07	0.18
1.00	0.31	0.29	0.14	0.20	0.06	0.14	0.11	0.24
1.25	0.46	0.36	0.20	0.25	0.08	0.18	0.16	0.30
1.50	0.94	0.54	0.41	0.38	0.17	0.27	0.22	0.36
1.75	1.56	0.72	0.68	0.51	0.28	0.35	0.29	0.42
2.00	2.32	0.90	1.00	0.64	0.42	0.44	0.37	0.48
2.25	3.21	1.08	1.39	0.76	0.58	0.53	0.46	0.53
2.50	4.22	1.26	1.83	0.89	0.76	0.62	0.55	0.59
2.75	5.36	1.44	2.31	1.02	0.97	0.71	0.66	0.65
3.00	6.62	1.62	2.86	1.15	1.19	0.80	0.77	0.71
3.25	8.02	1.80	3.45	1.27	1.44	0.88	0.88	0.77
3.50	9.52	1.98	4.10	1.40	1.70	0.97	1.01	0.83
3.75	11.16	2.17	4.81	1.53	1.99	1.06	1.14	0.89
4.00	12.90	2.35	5.53	1.66	2.30	1.15	1.28	0.95
4.25	14.74	2.53	6.32	1.78	2.63	1.24	1.43	1.01
4.50	16.74	2.71	7.18	1.91	2.98	1.33	1.59	1.07
4.75	18.85	2.89	8.05	2.04	3.34	1.41	1.75	1.13
5.00	21.06	3.07	8.99	2.16	3.73	1.50	1.92	1.19
5.25	23.36	3.25	9.98	2.29	4.14	1.59	2.09	1.25
5.50	25.74	3.43	11.00	2.42	4.56	1.68	2.27	1.31
5.75	28.21	3.61	12.12	2.55	5.00	1.77	2.46	1.37
6.00	30.94	3.79	13.22	2.67	5.46	1.86	2.67	1.43
6.25	33.76	3.97	14.43	2.80	5.96	1.95	2.86	1.49
6.50	36.49	4.15	15.60	2.93	6.44	2.03	3.08	1.54
6.75	39.51	4.33	16.90	3.06	6.98	2.12	3.29	1.60
7.00	42.63	4.51	18.23	3.18	7.49	2.21	3.51	1.66
7.25	45.85	4.69	19.50	3.31	8.06	2.30	3.75	1.72
7.50	49.16	4.87	20.91	3.44	8.64	2.39	3.99	1.78
7.75	52.57	5.05	22.36	3.57	9.19	2.48	4.24	1.84
8.00	56.06	5.25	23.85	3.69	9.81	2.56	4.47	1.90
8.25			25.83	3.82	10.43	2.65	4.72	1.96
8.50			26.95	3.95	11.08	2.74	4.99	2.02
8.75			28.55	4.07	11.74	2.83	5.26	2.08
9.00			32.04	4.33	13.10	3.01	5.56	2.14
9.25			35.50	4.58	14.60	3.18	5.84	2.20
9.50			39.32	4.84	16.08	3.36	6.13	2.26
9.75			43.31	5.09	17.72	3.54	6.41	2.32
10.00			47.18	5.35	19.30	3.71	6.71	2.38
10.25					21.06	3.89	7.05	2.44
10.50					22.88	4.07	7.35	2.50
10.75					24.76	4.24	7.66	2.55
11.00					26.71	4.42	7.98	2.61
11.25					28.71	4.60	8.35	2.67
11.50					30.77	4.77	8.67	2.73
11.75					32.89	4.95	9.00	2.79
12.00					35.06	5.13	9.38	2.85
12.25					37.28	5.31	9.72	2.91

Pressure drops owing to pipe friction (R) and calculated flow Speed (V) depending on peak flow (V_s)

Polypropylene pipes

Type3 in acc. With DIN 8077, nominal pressure Degree PN25

Peak Flow	DN 12 d _a = 20mm d _i = 12.0mm v = 0.1132 l/m		DN 15 d _a = 25mm d _i = 15.0mm v = 0.177 l/m		DN 20 d _a = 31mm d _i = 19.2mm v = 0.290 l/m	
	V _s L/s	R mbar/m	V m/s	R mbar/m	V m/s	R mbar/m
0.01	0.22	0.09	0.08	0.06	0.02	0.03
0.02	0.69	0.18	0.24	0.11	0.08	0.07
0.03	1.36	0.27	0.48	0.17	0.15	0.10
0.04	2.21	0.35	0.78	0.23	0.24	0.14
0.05	3.25	0.44	1.13	0.28	0.35	0.17
0.06	4.44	0.53	1.54	0.34	0.48	0.21
0.07	5.79	0.62	2.01	0.40	0.63	0.24
0.08	7.32	0.71	2.53	0.45	0.79	0.28
0.09	8.97	0.80	3.10	0.51	0.96	0.31
0.10	10.78	0.88	3.72	0.57	1.16	0.35
0.15	21.98	1.33	7.56	0.85	2.33	0.52
0.20	36.61	1.77	12.55	1.13	3.85	0.69
0.25	54.55	2.21	18.61	1.41	5.71	0.86
0.30	75.62	2.65	25.74	1.70	7.85	1.04
0.35	99.74	3.09	33.86	1.98	10.31	1.21
0.40	127.15	3.54	43.03	2.26	13.07	1.38
0.45	157.62	3.98	53.16	2.55	16.16	1.55
0.50	191.34	4.42	64.30	2.83	19.49	1.73
0.55	227.58	4.86	76.51	3.11	23.11	1.90
0.60	266.15	5.31	89.52	3.40	27.06	2.07
0.65			103.71	3.68	31.23	2.25
0.70			118.71	3.96	35.61	2.42
0.75			134.47	4.24	40.36	2.59
0.80			150.95	4.53	45.32	2.76
0.85			168.86	4.81	50.72	2.94
0.90			187.58	5.09	56.10	3.11
0.95			207.08	5.38	61.95	3.28
1.00					68.02	3.45
1.05					74.31	3.63
1.10					80.80	3.80
1.15					87.90	3.97
1.20					94.82	4.14
1.25					12.40	4.32
1.30					109.71	4.49
1.35					117.74	4.66
1.40					126.02	4.84
1.45					134.52	5.01
1.50					143.26	5.18
1.55					151.48	5.35

Pressure drops owing to pipe friction (R) and calculated flow Speed (V) depending on peak flow (V_s)

Polypropylene pipes

Type 3 in acc. With DIN 8077, nominal pressure Degree PN25

Peak Flow	DN 25 d _a = 40mm d _i = 24.0mm v = 0.452 l/m		DN 30 d _a = 50mm d _i = 30.0mm v = 0.707 l/m	
	V _s L/s	R mbar/m	V m/s	R mbar/m
0.05	0.12	0.11	0.04	0.07
0.10	0.40	0.22	0.14	0.14
0.15	0.81	0.33	0.28	0.21
0.20	1.33	0.44	0.46	0.28
0.25	1.97	0.55	0.68	0.35
0.30	2.70	0.66	0.93	0.42
0.35	3.54	0.77	1.22	0.50
0.40	4.49	0.88	1.55	0.57
0.45	5.52	0.99	1.90	0.64
0.50	6.67	1.11	2.28	0.71
0.60	9.20	1.33	3.16	0.85
0.70	12.12	1.55	4.15	0.99
0.80	15.44	1.77	5.27	1.13
0.90	19.04	1.99	6.48	1.27
1.00	23.00	2.21	7.48	1.14
1.10	27.34	2.43	9.28	1.56
1.20	31.95	2.65	10.85	1.70
1.30	36.98	2.87	12.57	1.84
1.40	42.29	3.09	14.32	1.98
1.50	48.09	3.32	16.21	2.12
1.60	53.93	3.54	18.27	2.26
1.70	60.30	3.76	20.34	2.41
1.80	66.94	3.98	22.58	2.55
1.90	73.85	4.20	24.92	2.69
2.00	81.01	4.42	27.35	2.83
2.10	88.87	4.64	29.86	2.97
2.20	96.55	4.86	32.61	3.11
2.30	104.99	5.08	35.28	3.25
2.40	113.73	5.31	38.04	3.40
2.50			41.06	3.54
2.60			44.19	3.68
2.70			47.17	3.82
2.80			50.46	3.96
2.90			53.85	4.10
3.00			57.33	4.24
3.10			60.89	4.39
3.20			64.54	4.53
3.30			68.28	4.67
3.40			72.09	4.81
3.50			75.99	4.95
3.60			80.39	5.09
3.70			84.46	5.23
3.80			88.61	5.38

Pressure drops owing to pipe friction (R) and calculated flow Speed (V) depending on peak flow (V_s)

Polypropylene pipes

Type3 in acc. With DIN 8077, nominal pressure Degree PN25

Peak Flow	DN 40 d _a = 63mm d _i = 37.8mm v = 1.122 l/m		DN 45 d _a = 75mm d _i = 45.0mm v = 1.590 l/m	
	V _s L/s	R mbar/m	V m/s	R mbar/m
0.10	0.05	0.09	0.02	0.06
0.20	0.15	0.18	0.07	0.13
0.30	0.31	0.27	0.14	0.19
0.40	0.51	0.36	0.22	0.25
0.50	0.76	0.45	0.33	0.31
0.75	1.55	0.67	0.67	0.47
1.00	2.58	0.89	1.12	0.63
1.25	3.84	1.11	1.66	0.79
1.50	5.32	1.34	2.30	0.94
1.75	7.01	1.56	3.03	1.10
2.00	8.91	1.78	3.85	1.26
2.25	11.06	2.00	4.76	1.41
2.50	13.32	2.23	5.74	1.57
2.75	15.88	2.45	6.81	1.73
3.00	18.62	2.67	7.98	1.89
3.25	21.52	2.90	9.23	2.04
3.50	24.57	3.12	10.54	2.20
3.75	27.91	3.34	11.98	2.36
4.00	31.42	3.56	13.42	2.52
4.25	35.09	3.79	14.99	2.67
4.50	38.92	4.01	16.63	2.83
4.75	43.12	4.23	18.43	2.99
5.00	47.26	4.46	20.20	3.14
5.25	51.81	4.68	22.03	3.30
5.50	56.54	4.90	24.05	3.46
5.75	61.11	5.12	26.14	3.62
6.00	66.16	5.35	28.14	3.77
6.25			30.37	3.93
6.50			32.66	4.09
6.75			35.02	4.24
7.00			37.44	4.40
7.25			39.94	4.56
7.50			42.49	4.72
7.75			45.11	4.87
8.00			48.06	5.03
8.25			50.82	5.19
8.50			53.62	5.34

6. Determination of Total Pressure loss of the installation

- ❖ The calculations of flow rates of the individual take-off points are summed in a direction and are assigned to the corresponding pipe sections as cumulative flow rates.
- ❖ The dimensions are calculated from the sum of continuous flow rates and peak rates.
- ❖ The continuous flow rates is regarded as the quality which emerges when water is removed for more than 15 minutes, converted to liter per second.
- ❖ Values for the conversion of cumulative flow rates in to peak flow rates are shown in diagram.
- ❖ In association with international pipe diameter. The peak flow rates determine the pressure gradient due to pipe friction.
- ❖ The total pressure loss of the pipe (without equipment resistance) is the sum of the pressure losses due to pipe friction and individual resistance.
- ❖ The coefficients of resistance of pipeline sections and individual resistance are shown in table
- ❖ The total pressure loss of the pipe can be determined with the aid of the relevant equation:

$$\Delta P = \Sigma(R \times L + Z)$$


$$Z = \zeta \cdot \frac{V^2 \cdot e}{2}$$

Peak Flow

Peak flow V_s depending on summation flow ΣV_R

Area of Applications [VR >= 20 L/s]	
Residential buildings	(A)
Office and Administrative Buildings	(C)
Hotel Buildings	(F)
Department Stores	(G)
Hospitals (only ward sections)	(H)
Schools	(K)

Area of Applications [VR >= 20 L/s]		
	[VR >= 1.5 L/s]	[VR <= 1.5 L/s]
Residential buildings	(A)	(B)
Office and Administrative Buildings	(A)	(B)
Hotel Buildings	(D)	(E)
Department Stores	(D)	(E)
Hospitals (only ward sections)	(D)	(E)
Schools $\Sigma V_s = V_s \text{ von } 0,1 \text{ bis } 1,5 \text{ L/s}$ $\Sigma V_R >= 1,5 \text{ L/s}$	(I)	

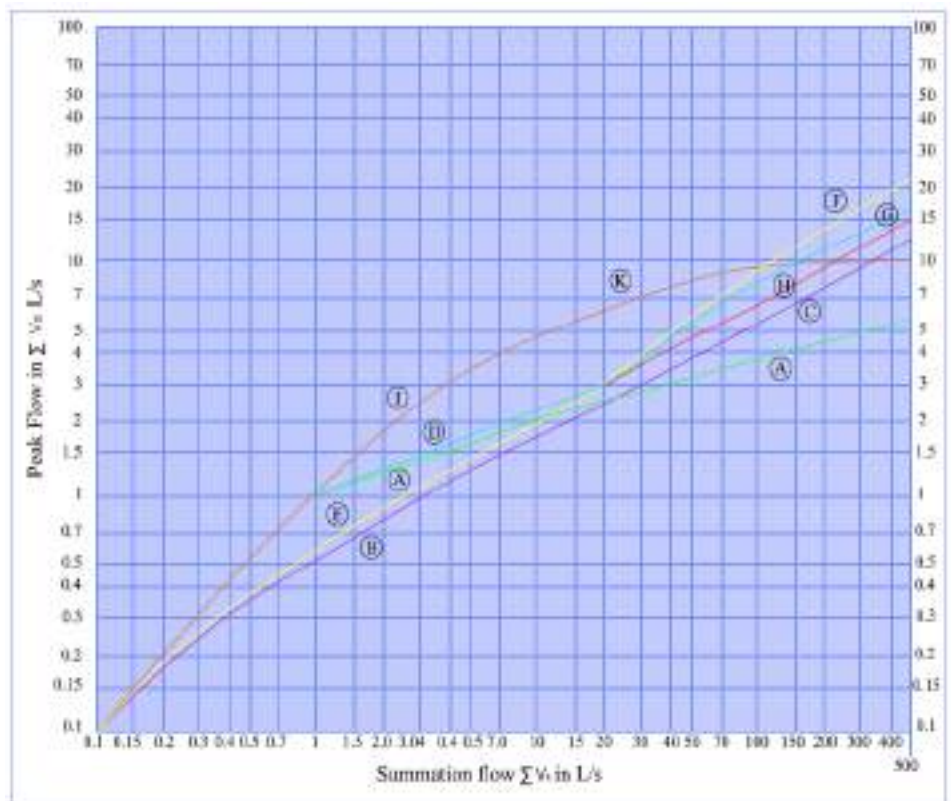

Resistance Coefficient Values

Resistance Coefficient Values ζ_u for piping junctions

No.	Designation	Graphic Symbols	Loss coefficients	No.	Designation	Graphic Symbols	Loss coefficients				
1	Branching. One sided dividing flow		1.3	14	Elbow joints 90° smooth		1.13				
2	Branching. One sided merging flow		0.9		Elbow joints 90° rough		1.27				
3	Branching one-sided passage for dividing flow		0.3	15	Widening steady $\beta = 10^\circ$ $= 20^\circ$ $= 30^\circ$ $= 40^\circ$		0.20				
4	Branching one-sided passage for merging flow		0.6				Widening sudden	$(F1/F2=1)^2$			
5	Branching one sided counter-current for merging flow		3.0				Widening free discharge	1.0			
6	Branching one sided counter-current for dividing flow		1.3	16	Narrowing steady		0.40				
7	Branching, one sided bow shaped dividing flow		0.9				Reductions	0.50			
8	Branching one sided bow shaped, merging flow		0.4				1 dimensions	0.60			
9	Branching one sided bow shaped passage for dividing flow		0.3				2 dimensions	0.70			
10	Branching one sided bow shaped passage for merging flow		0.2				3 dimensions	0.80			
11	Branching with 2 exit pipes (casing reservoir)		0.5				4 dimensions	0.80			
13	Bow 90° smooth R=d =2d =4d =6d =10d		0.21	17	Smooth comp tube bend quill		0.7				
			0.14				comp tube bend	1.4			
			0.09				corrugated comp tube	2			
			0.11				18	Screw-down stop Globe valve		8.5	
			0.51							DN20	7.0
			0.30							DN25	2.5
0.23	19	Slanted set valves		2.0							
0.18				DN20	1.5						
0.20	20	Full current valve		2.0							
13				Bow 90° rough R=d =2d =4d =6d =10d		0.51	21	Main slide valve		0.5	
	0.30	DN20									
	0.23	DN25									
	0.18	Corner valves				2.0					
	0.20										

8. QUALITY CONSIDERATIONS

The deciding factor in the VIALIPP-Rc pipes and fittings manufacturing process is the use of correct/ pure raw materials.

- ❖ Pipes and pipe fittings consist of long-lasting PP-Rc material properties and characteristics.
- ❖ Has a direct impact on the welding quality (example: the melting point of PP-Rc material is 140 °C that of PP-B material is about 160 °C) welding conditions become different so that the welding quality is easy to grasp. This is because two kinds of crystalline materials used in the PP blend mix have varying melting degrees.
- ❖ The cooling rate is different in the welding process due to the different shrinkage rates which leads to stress concentration.
- ❖ When the raw material is mixed with a number of recycling industrial waste plastic granulates, the pipes and fittings produced could be toxic and thus not suitable for long-term use to transport drinking water this will seriously damage people's health.
- ❖ During the welding process, there is an odor and an emission of black smoke.
- ❖ The lifespan of such pipes and fittings is rather short. Leakage problems will probably start within the first few months of regular use. The repair and replacement costs, especially in occupied residential units, will be much higher.

The production machines also play an important role in ensuring a quality product. Low-quality suppliers tend to use inexpensive equipment for their manufacturing process. For example, pipes may be produced with uneven wall thickness throughout the pipe. This can significantly impact the quality of the pipe and its chemical/thermal characteristics.

9. FREQUENTLY ASKED QUESTIONS

Q: Which is the raw material used to produce VIALLI PP-Rc Pipe system?

ANSWER

PP-Rc pipe systems are produced from a type of polypropylene known as polypropylene random copolymer, often referred to as Type III PP-Rc (commonly known as PPR). This raw material is obtained through the cracking of petroleum, where propane-monomer polymerizes with polypropylene co-monomer to form polypropylene random copolymer. We exclusively utilize one of the best PP-Rc raw materials globally, approved for the production of pipes and fittings in accordance with DIN 8078 and DIN 16962 standards.

Q: How are the pipes and Fittings manufactured using this raw material?

ANSWER

The PP-Rc raw material is a thermoplastic resin supplied in pre-colored granules. This raw material is transformed into finished products by raising the temperature, which plasticizes the material. This process allows the production of pipes through extrusion and fittings through molding.

Q: What do PP-Rc type 1 Type, Type 2 and Type 3 refer to? What are the difference between them?

ANSWER

Plastic pipes have become more resistant as they have evolved. The first produced polypropylene had a structure consisting of propylene molecules, which was referred to as Type 1 Polypropylene homo-polymer. Later, propylene molecules with mixed sequences were introduced alongside the propylene molecules, leading to what is known as Type 2 Polypropylene block copolymer. Subsequently, the Type 3 product was developed, which includes ethylene molecules regularly sequenced among the propylene molecules.

Today, due to their specific characteristics, Type 2 and Type 3 are widely used. Type 2 is employed primarily in cold water networks and is not suitable for use with hot fluids. On the other hand, Type 3 can be used for hot water systems because it offers resistance to hot fluids.

Q: Are VIALLI pipes UV resistant?

ANSWER

VIALLI PP-Rc pipes and fittings possess adequate UV stability to protect them from UV rays. Nevertheless, it is not advisable to continuously expose these pipes and fittings to direct sunlight for outdoor pipeline installations. It is recommended to apply an acrylic paint coating to the pipes or to shield them from direct sunlight by providing a protective covering or installing them in a duct. This precaution helps extend the lifespan and maintain the performance of the pipes and fittings when used outdoors.

Q: Is insulation necessary for hot water applications?

ANSWER Normally, it is not mandatory for plumbers to install insulation because the thermal conductivity of PP-Rc piping systems is lower compared to metal piping systems (0.24 W/mK). However, for centralized heating systems, where preventing heat loss and isolating pipelines from other utilities is important, it is advisable to insulate these lines. The required thickness of insulation is significantly lower compared to conventional lines due to the inherent properties of PP-Rc piping systems.

Q: How can we connect VIALLI products to other metal systems?

ANSWER VIALLI PP-Rc system can be connected to other metal systems easily by a flange or a metal adaptor. (BS 6920)

Q: What is DIN Standards?

ANSWER The Deutsches Institut für Normung (DIN) is Germany's institute for standardization. It is a technical and scientific association recognized by the German government as the national standards body representing Germany's interests at international and European levels. DIN provides a forum in which representatives from manufacturing industries, consumer organizations, commerce, the trades, service industries, science and technical inspectorates, and government can discuss and define their specific standardization requirements, recording the results as German Standards.

Q: What are production standards of VIALLI PP-Rc ?

Following standards are used for the production of VIALLI pipes and fittings:

Standard	Concern Production
DIN 8076	Standard for Testing metal threaded joints
DIN 8077	Polypropylene Pipes. Dimensions
DIN 8078	Polypropylene Pipes, General Quality Requirements & Testing
DIN 16962	Pipe joints and elements for Polypropylene Pressure Pipes
DIN 1988	Drinking Water Supply Systems, Materials, Components, Appliances Design and installation
DIN 16928	Pipe joints & Elements for Pipes, Laying-General Directions
DIN 2999	Standard for fittings with threaded metallic insert
EN ISO - 15874	Plastic piping system for hot & cold water Installation – (PP)
BS 6700	Design, Installation, Testing and Maintenance of Services Supplying Water for Domestic use with in buildings and their Cartilages
DVS 2207	Welding of Thermoplastics
DVS 2208	Welding Machines and Devices for Thermoplastics

Q: What is the service life (life span) of VIALLI PP-Rc piping systems for different pressure groups?

ANSWER

PP-RC pipes have a service life of 50 years according to DIN Standards for in house applications. To have detailed information for Different temperatures and pressure rates, please refer product catalogue

Q: Are VIALLI PP-Rc pipes used for drinking water? Are they Hygienic/ Healthy?

ANSWER

PP-Rc products can safely be used for Drinking water. VAILLI PP-Rc products have got all international Approvals as well as the approvals of the sales territories

Q: What does PN Stands for and what does it mean to be PN-16 or PN20?

ANSWER

PN stands for Nominal Pressure, it is numerical designation used for reference purpose related to mechanical characteristics of the component of a piping system. A PN-20 pipe mean the pipe can withstand pressure Up to 20 Bars.

Q: Why is VIALLI fittings categorized under PN-25 Types?

ANSWER

VIALLI fittings can withstand temperature above 95°C and pressure up to 25 kg/ cm², (25 Bars) hence categorized under PN-25.

Q: What does PN Stands for and what does it mean to be PN-16 or PN20?

ANSWER

PN stands for Nominal Pressure, it is numerical designation used for reference purpose related to mechanical characteristics of the component of a piping system. A PN-20 pipe mean the pipe can withstand pressure Up to 20 Bars.

Q: What is the difference between PN16 and PN20 pipes due to the application areas?

ANSWER

Life Span of PN20 is Longer than PN-16 pipes under the same temperature and pressure conditions. Especially for the exposed installations as the expansion of PN-20 pipes are 1/5 of PN 16 pipes sagging and snaking problems are avoided.

Q: How is pipe categorized as PN-10, PN-16, PN-20 & PN25 matched with SDR (Standard Dimension Rate) of conventional pipes?

ANSWER

PP-Rc Pipes with all thickness of OD/ SDR is matched as the Equivalent PP-Rc Pipe for a SDR Pipe.

PN-10 is regarded as equivalent to SDR 11 Because, PN 10 Pipe of 20 mm OD has thickness approx. to $20/11=1.8$

PN-10 160 mm has thickness approx. to $160/11=14.55$
Likewise SDR 7.4 is matched as PN-16 and SDR 6 as PN-20.

Q: What is the intended use of different classes of Pipes?

ANSWER

PN 10 – Cold water distribution and floor heating systems

PN 16 – Higher pressure cold water distribution and domestic hot water system at lower Pressures.

PN 20 – hot water distribution Central

PN 25 - Higher pressure Hot water distribution Central and Domestic

Q: What should be done if somebody accidentally drills a hole on the pipe?

ANSWER

If it is a nail or a drill hole (10.5mm deep max) you may use "VIALLI PP-Rc Hole Repair Kit to repair the hole on the pipe. If the damage part of the pipe is not concealed yet (before the pressure test is conducted), the recommended procedure is to cut that part and replace it by a new part through normal welding of a socket.

Q: Should any precaution be taken for the installation at low temperatures?

ANSWER

At lower temperature of 0°C and below, the flexibility of PP-Rc pipes reduces and impact strength also reduces. This makes pipes more prone to mechanical damages against impact loads. To avoid the damages at low temperature, it is advisable to insulate the pipe lines

Q: Do VIALLI PP-Rc Piping systems burn?**ANSWER**

VIALLI pipes and fittings have a combustion point of 330°C and a burning point of 360°C. These properties conform to the B2 (Normally inflammable) class fire requirements for normal combustibility according to DIN 4102. In the event of a fire, PP-Rc pipes and fittings emit carbon dioxide and water. Additionally, depending on the availability of oxygen, small amounts of carbon monoxide gas, molecular hydrocarbons, and oxidation products may also be emitted. Even in cases of incomplete combustion, the materials emitted are less toxic than those from wood or conventional pipe systems under similar conditions.

Q: How can the PP-Rc pipes & fittings joined together?**ANSWER**

The process of joining PP-Rc pipes and fittings is very simple and results in inseparable water joints. This is achieved using a straightforward welding machine that melts the internal surface of the fittings and the external surface of the pipe at 270°C, allowing the material of the pipe and the fitting to meld together. Because both the pipes and fittings are produced from the same material, the connection is typically homogeneous.

Q: Can the pipes alignment be adjusted after the welding process?**ANSWER**

A girth up to 5 degree relative to the axis of the pipe can be done immediately after jointing.

Q: How is the pipe cutting recommended?**ANSWER**

It is advised to used sharp cutting tools to cut the pipe with no burrs, VIALLI Provide cutting tools of size 20-40, 20-63, 50-110, 160, 200 & 250.

Q: How is the size of pipes and fittings measured?**ANSWER**

Pipes size is measured by mm (millimeter) of its outer Dia. PRR fittings are measured by mm (millimeter) of inner dia. and metal threaded fittings treaded side size is measured in inches

Q: Which is the metal used in manufacturing of VIALLI Threaded fittings?**ANSWER**

VIALLI Threaded fittings are manufactured using stainless steel inserts, tin bronze inserts, brass with nickel plated inserts & natural brass inserts and its threading is made as per British Standard Threading.

Q: How can the stressing of pipe be avoided?**ANSWER**

Possible linear thermal expansion/contraction needs to be taken into consideration during designing and installing. Stressing of pipes can be avoided by providing flexible free length and proper supporting.

Q: Why is joining of pipes without using sockets un-recommended?**ANSWER**

This joining results blockage or reduction in inner Dia. At joining point hence it's recommended to avoid as it can affect the function of the system.

Q: Is joining of pipes & fittings using glue recommended?**ANSWER**

Using glue connections is not recommended as they cannot provide a 50-year guarantee against leakages. Additionally, glue connections are susceptible to issues like termite attacks and frequent maintenance requirements, which can impact the hygienic and long-term performance of the VIALLI PP-Rc Pipe system.

Q: How is pressure testing recommended?**ANSWER**

Before any pipes are filled or cemented in concealed applications, they must undergo hydrostatic testing to check for pressure loss or leaks. The testing involves pressurizing the closed system, with all ends sealed using caps and pipe plugs, with water up to 25 bar for PN-20 and PN-25 pipes, and up to 15 bar for PN-16 pipes, all at room temperature. The pressure should be maintained for at least 8 hours to detect any pressure drop. This process is repeated to confirm the absence of even minor leaks. If a significant pressure drop is observed, the specific area of leakage must be identified and rectified.

10. VIALLI GLASS FIBER REINFORCED PIPE

PRODUCT DESCRIPTION

FR-PPR Glass Fiber-reinforced hot and cold water composite pipes are three-layer co-extruded pipes. They are produced at low temperatures with high-speed production techniques and offer the special advantages of PP-Rc pipes. Additionally, they possess the following characteristics:

1. The linear expansion coefficient is only about 20-30% of that of ordinary PP-Rc pipes.
2. Enhances pipe rigidity, prevents sagging, provides additional support points, and thereby reduces the total installation cost.
3. Higher pressure resistance level and longer working life under several working conditions. (95 °C at 10bar for short time test 200 hours) 95 °C at 6.5 Bar for a service time 50 years.
4. Permanently solves the issue of oxygen ingress into the pipeline, ensuring that it does not appear on the inner surface. The middle layer of the FR-PPR pipe effectively prevents oxygen intrusion, inhibiting algae growth and maintaining fresh, pure water.
5. Exhibits good resistance to ultraviolet radiation, ensuring that the installation remains free from deformation.
6. Low thermal conductivity
 - ❖ PP-Rc Aluminum composite pipe coefficient of thermal conductivity is 190w/mk
 - ❖ PP-Rc Glass fiber composite pipe coefficient of thermal conductivity is 110w/mk ideal choice for outdoor construction of solar and heat energy system.

Raw Material and Technical Specifications

- ❖ Pipe Type: PP-Rc Glass-Fiber Reinforced
- ❖ Elongation coefficient: 0.035 mm/mk
- ❖ Fields of use: Heating, Cooling, internal and external cold and hot domestic water supply pipes system.

Liner Expansion Table for the VIALLI Composite Pipes


Amount of elongation (ΔL) (mm) :

length M	ΔT						
	10°C	20°C	30°C	40°C	50°C	60°C	70°C
5	2	4	6	8	10	12	14
10	4	8	12	16	20	24	28
15	6	12	18	24	30	36	42
20	8	16	24	32	40	48	56

10. Vialli Glass Fiber Reinforced Pipe

Product Description

Compares the amount of elongation from the glass fiber reinforcement PP-Rc pipe with the standard PP-Rc pipe

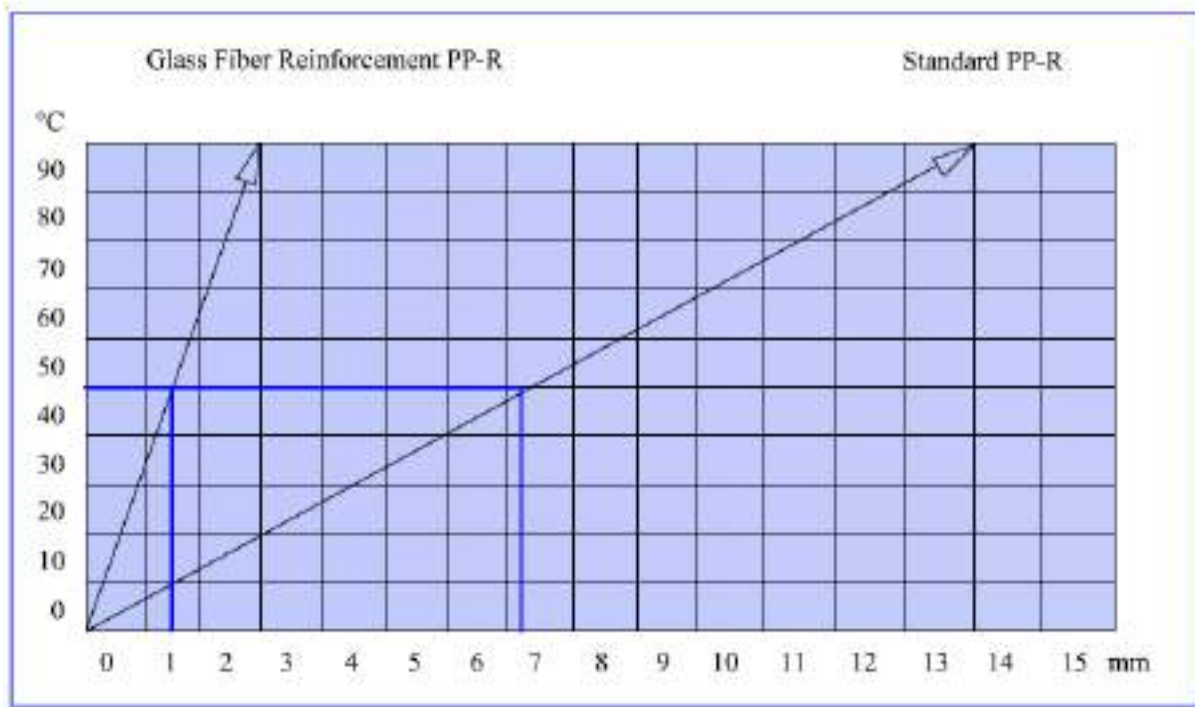

While fiberglass reinforced PP-Rc pipes elongate by 1.75mm per 1 meter at a temperature difference of 50°C, standard PP-Rc pipes elongate by 7.5mm per 1 meter under the same temperature difference.

Code	Measure	Packet
VPPR20FG	20x3.4mm	100
VPPR25FG	25x4.2mm	100
VPPR32FG	32x5.4mm	60
VPPR40FG	40x6.7mm	40
VPPR50FG	50x8.4mm	20
VPPR63FG	63x10.5mm	16
VPPR75FG	75x12.5mm	12
VPPR90FG	90x15mm	8
VPPR110FG	110x18.3mm	4
VPPR160FG	160x26.6mm	4
VPPR200FG	200x28.3mm	4
VPPR250FG	250x33.3mm	4

11. Vialli Aluminum Reinforced Pipe

Product Description

VIALLI PN25 pipes (with an aluminum layer) consist of inside and outside layers made of PP-Rc. These layers are securely bonded to the middle layer, which is an aluminum core, using a PP-based adhesive and are well-welded in an overlapping manner. This type of pipe represents a perfect combination of a metal pipe and a plastic pipe.

Advantages

- ❖ Greatly reduces linear expansion coefficient, only $\frac{1}{4}$ of that of PP-Rc, which means the composite pipes have stable dimensions.
- ❖ 100% Oxygen tightness, suitable for heating system.
- ❖ Improved resistance to impulse under low temperature.
- ❖ Works under High temperatures and pressures for cool and hot water systems.
- ❖ Easily detectable when embedded, due to the presence of the metal layer.
- ❖ Excellent heat preservation performance with a low thermal conductivity coefficient of 0.45 W/m·K.
- ❖ Smooth and hygienic, making it an excellent choice for drinkable water systems.

Advantages

- ❖ Suitable for the distribution of both cold and hot water.
- ❖ Pipes for a variety of high-temperature and low-temperature heating systems.
- ❖ Pipes for heating and cooling settings in solar energy systems.
- ❖ Duct for drinkable water system.
- ❖ Industrial transportation for chemical liquids.
- ❖ Pipes for connecting air conditioners.
- ❖ High-pressure pipes for irrigation systems.

12. Fittings inserts

The durability of fittings is significantly influenced by their resistance to corrosion. Hence, we utilize various types of metal inserts in the manufacturing of male and female VIALLI fittings, as elaborated below.

12.1 Stainless Steel Inserts

- ❖ Vialli Stainless Steel Fittings have low Interior surface friction, remain stable under extreme temperatures.
- ❖ Vialli Stainless Steel Fittings like the ones link plus installs to be among the most Durable option available
- ❖ The standard for producing Vialli Stainless Steel PP-Rc Fittings DIN 17440 and DIN 17441
- ❖ **Life Span** for Vialli Stainless Steel PP-Rc fittings under Marin environment 35-50 Years

12.2 Tin Bronze Inserts

- ❖ Excellent properties of Copper-Tin alloys-Gun Metal- of Vialli Bronze PP-Rc Fittings.
- ❖ All Bronze Inserts with the following Technical Specifications (CuSn₅ Zn₅Pb₅-C), (CuSn₅ Zu₅ Pb₂-C)
- ❖ **The lifespan** of the Vialli Tin Bronze Fittings under Marine Environments is approximately 30-45 years.

12.3 DZR Brass Chrome Platted

- ❖ VIALLI DZR Brass Chrome Plated PP-Rc fittings are widely used globally, known for their high quality and competitive pricing.
- ❖ The VIALLI DZR Brass Chrome-plated PP-Rc Fittings come with the following technical specifications: (CuZn39 Pb2), (CuZn39 Pb3), (CuZn40 Pb2).
- ❖ The Surface Treatment Chrome Plated as Per DIN 259 and BS 2779
- ❖ **The life Span** for Vialli DZR Brass Chrome plated Fittings is approximately 25-35 years.

12.4 Natural Brass Insert

- ❖ VIALLI Natural Brass fittings are produced with technical specifications similar to Brass with Nickel Plating but without undergoing any surface treatment.
- ❖ It represents a less durable alternative.
- ❖ **Life Span** for Vialli Natural Brass PP-Rc Fittings under Marine Environments is approximately 15-20 years.

13. INSTALLATION RECOMMENDATIONS

- ❖ Handling the VIALLI installation system does not fundamentally differ from the installation scheme for metallic pipes.
- ❖ Fittings and fixtures commonly used in the trade, as well as insulation materials in accordance with heating installation regulations, may be applied in the traditional manner.
- ❖ The planning and execution of drinking water systems are conducted in compliance with DIN 1988, which encompasses the "Technical Regulations on Drinking Water Systems."
- ❖ It can be used in mixed systems, for example, during repair work without any issues.
- ❖ The minimal number of tools needed simplifies the handling of the entire system.
- ❖ Owing to the extensive fitting programmed, appropriate molded parts are required for each mode of installation, e.g. wall installations are available.
- ❖ Connecting with existing VIALLI systems can be seamlessly accomplished using welding saddles.
- ❖ Installations elements subject to frequent use can be pre-assembled (welded) in the workshop.

To make sure that our system is installed in a professional manner, the following recommendation should be observed:

- ❖ Avoid the presence of bubbles inside the piping.
- ❖ Install piping in an upward direction towards the tapping point.
- ❖ Place aerators and ventilation devices at the upper end of the ascending part of the line and evacuation points at the lower end.
- ❖ Mount separate cut-offs for ascending phases, apartment piping, pressure risers, hot water boilers, and garden piping.
- ❖ Always secure pipe fittings with inserts to prevent sound transmission.
- ❖ Avoid contact with structural elements when passing pipes through walls and ceilings to eliminate sound transmission.
- ❖ Account for pipe elongation when welding, as welding at outdoor temperatures below 0°C is possible only under specific conditions.

Welding Operations



1.) Cut the pipe perpendicular to its axis

2.) Heating the pipe and the fitting simultaneously.



3.) Within the allowed time interval, connect the pipe and Fitting **(do not twist)**

4.) Ensure that the pipe and fittings are joined with a welding process that is 100% secure.



Recommended values for welding of PP-Rc pipe at an outdoor temperature of 20 °C & medium air movement (time Requirement)

1	2	3	4	5	DVS 2207
External pipe Dia. mm	Insert depth mm	Heating period Sec.	Processing period sec.	Cooling period Mins.	
20	14	5	3		With hand welding device
25	15	7	3		
32	16.5	8	4	2	
40	18	12	6	4	
50	20	18	7		
63	24	24	8	6	With welding machine
75	26	30	10	8	
90	32	40	10	8	
110	38.5	50	15	10	
125	40	55	17	12	
160	43	65	20	14	
200	46	72	25	17	
250	50	78	27	20	

PP-Rc PRODUCTS

Our products include PP-Rc pipes designed for indoor cold and hot water distribution systems, floor and central heating systems, air distribution systems, and various applications in industry and agriculture. The lightweight nature of our pipes, coupled with their ease of processing, ensures quick, straightforward, and safe installations. Our welding concept, combined with the low roughness of the internal surface, contributes significantly to minimizing pressure losses in piping distribution systems.




1.) SDR 7.4 PP-Rc Pipes (Single Layer)

Our 4m pipes, designed for the highest pressure range, are ideal for hot water distribution systems, including applications in high-rise buildings, apartments, and panel buildings. These pipes are equivalent to **PN 16** with a safety factor of 1.5, ensuring their durability and reliability in demanding environments.



Standards: DIN 8077 / DIN 8078 / DIN 16962 / EN ISO 15874

Size (D)	Inner Dia.	SDR	(S) Wall Thickness	CODE
20mm	14.4mm	7.4	2.8mm	VPPR2016
25mm	18.0mm	7.4	3.5mm	VPPR2516
32mm	23.2mm	7.4	4.4mm	VPPR3216
40mm	29.0mm	7.4	5.5mm	VPPR4016
50mm	36.2mm	7.4	6.9mm	VPPR5016
63mm	45.8mm	7.4	8.6mm	VPPR6316
75mm	54.4mm	7.4	10.3mm	VPPR7516
90mm	65.4mm	7.4	12.3mm	VPPR9016
110mm	79.8mm	7.4	15.1mm	VPPR11016
160mm	116.2mm	7.4	21.9mm	VPPR16016
200mm	153.6mm	9	23.2mm	VPPR20016
250mm	195.4mm	9	27.3mm	VPPR25016

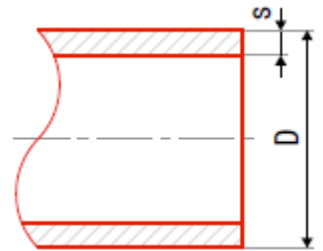


2.) SDR 6 PP-Rc Pipes (Single Layer)

Our 4m pipes, designed for the highest pressure range, are perfectly suited for hot water distribution systems, including applications in high-rise buildings, apartments, and panel buildings. These pipes are equivalent to **PN 20** with a safety factor of 1.5, ensuring their reliability and safety in demanding environments.

Standards: DIN 8077 / DIN 8078 / DIN 16962 / EN ISO 15874

Size (D)	Inner Dia.	SDR	(S) Wall Thickness	CODE
20mm	13.2mm	6	3.4mm	VPPR20
25mm	16.6mm	6	4.2mm	VPPR25
32mm	21.2mm	6	5.4mm	VPPR32
40mm	26.6mm	6	6.7mm	VPPR40
50mm	33.2mm	6	8.4mm	VPPR50
63mm	42.0mm	6	10.5mm	VPPR63
75mm	50.0mm	6	12.5mm	VPPR75
90mm	60.0mm	6	15mm	VPPR90
110mm	73.2mm	6	18.4mm	VPPR110
160mm	106.4mm	6	26.6mm	VPPR160
200mm	143.4mm	7.4	28.3mm	VPPR200
250mm	183.0mm	7.4	33.3mm	VPPR250

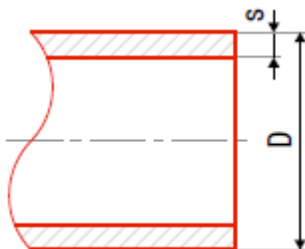


3.) SDR 7.4 Multilayer PP-Rc Pipes (Fiber Glass Layer)

Our 4m pipes are well-suited for hot water distribution systems in locations with lower ceilings, as well as for heating and cooling water distribution systems in hot water heating systems or air conditioning systems. The installation of these pipes does not require the use of any supporting gutters. They are equivalent to **PN 20** with a safety factor of 1.5, ensuring their durability and reliability.



Standards: DIN 8077 / DIN 8078 / DIN 16962 / EN ISO 15874

Size (O.D)	d.i	SDR	Wall Thickness	CODE
20mm	14.4mm	7.4	2.8mm	VPPR20FG20
25mm	18.0mm	7.4	3.5mm	VPPR25FG20
32mm	23.2mm	7.4	4.4mm	VPPR32FG20
40mm	29.0mm	7.4	5.5mm	VPPR40FG20
50mm	36.2mm	7.4	6.9mm	VPPR50FG20
63mm	45.8mm	7.4	8.6mm	VPPR63FG20
75mm	54.4mm	7.4	10.3mm	VPPR75FG20
90mm	65.4mm	7.4	12.3mm	VPPR90FG20
110mm	79.8mm	7.4	15.1mm	VPPR110FG20

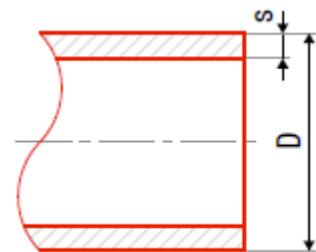


4.) SDR 6 Multilayer PP-Rc Pipes (Fiber Glass Layer)

Our universal 4m pipe is designed to meet the demands of the most challenging drinking, cooling, and heating water distribution systems. It offers the advantage of having thermal expansion four times lower than that of a standard PP-RC pipe while maintaining high stiffness. It can be welded just like a common PP-RC pipe. This pipe is ideal for basic distribution systems; these pipes are equivalent to **PN 25** with a safety factor of 1.5.



Standards: DIN 8077 / DIN 8078 / DIN 16962 / EN ISO 15874

Size (O.D)	d.i	SDR	Wall Thickness	CODE
20mm	13.2mm	6	3.4mm	VPPR20FG
25mm	16.6mm	6	4.2mm	VPPR25FG
32mm	21.2mm	6	5.4mm	VPPR32FG
40mm	26.6mm	6	6.7mm	VPPR40FG
50mm	33.2mm	6	8.4mm	VPPR50FG
63mm	42.0mm	6	10.5mm	VPPR63FG
75mm	50.0mm	6	12.5mm	VPPR75FG
90mm	60.0mm	6	15mm	VPPR90FG
110mm	73.2mm	6	18.4mm	VPPR110FG
160mm	106.4mm	6	26.6mm	VPPR160FG
200mm	143.4mm	7.4	28.3mm	VPPR200FG
250mm	183.0mm	7.4	33.3mm	VPPR250FG

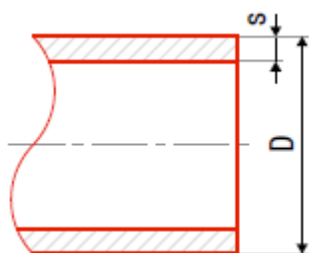


5.) SDR 6 Multilayer PP-Rc Pipes (Aluminum Layer)


Our 4m pipe is ideal for hot water distribution systems in locations with lower ceilings, as well as for heating and cooling water distribution systems in hot water heating systems or air conditioning systems. These pipes offer the advantages of low thermal expansion and high stiffness, making them suitable for various applications. These pipes are equivalent to PN 25 with a safety factor of 1.6, ensuring their reliability and performance in demanding scenarios.



Standards: DIN 8077 / DIN 8078 / DIN 16962 / EN ISO 15874

Size (O.D)	d.i	SDR	Wall Thickness	CODE
20mm	13.2mm	6	3.4mm	VPPR20A
25mm	16.6mm	6	4.2mm	VPPR25A
32mm	21.2mm	6	5.4mm	VPPR32A
40mm	26.6mm	6	6.7mm	VPPR40A
50mm	33.2mm	6	8.4mm	VPPR50A
63mm	42.0mm	6	10.5mm	VPPR63A
75mm	50.0mm	6	12.5mm	VPPR75A
90mm	60.0mm	6	15mm	VPPR90A
110mm	73.2mm	6	18.4mm	VPPR110A

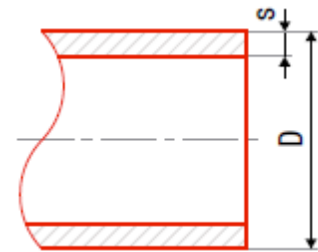

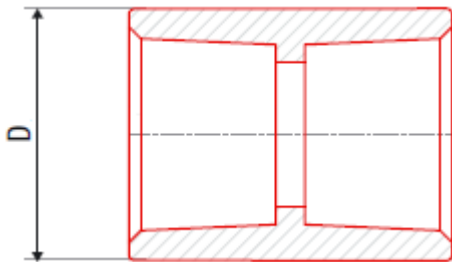

6.) Coupling (Equal Socket)


Our piping systems allow for easy interconnection of individual pipes within a water or heating distribution system, minimizing pressure loss.

Size (D)	Description	CODE
20mm	Equal Socket	VS1
25mm	Equal Socket	VS2
32mm	Equal Socket	VS3
40mm	Equal Socket	VS4
50mm	Equal Socket	VS5
63mm	Equal Socket	VS6
75mm	Equal Socket	VS7
90mm	Equal Socket	VS9
110mm	Equal Socket	VS10
160mm	Equal Socket	VS16
200mm	Equal Socket	VS20
250mm	Equal Socket	VS25

7.) Equal Tee

Our fittings facilitate the branching of a distribution system while ensuring that the inside diameter of the fittings remains unchanged compared to the inside diameter of the piping. As a result, these fittings do not significantly increase the pressure loss in the distribution system.



Size (D)	Description	CODE
20x20x20mm	Equal Tee	VT1
25x25x25mm	Equal Tee	VT2
32x32x32mm	Equal Tee	VT3
40x40x40mm	Equal Tee	VT4
50x50x50mm	Equal Tee	VT5
63x63x63mm	Equal Tee	VT6
75x75x75mm	Equal Tee	VT7
90x90x90mm	Equal Tee	VT9
110x110x110mm	Equal Tee	VT10
160x160x160mm	Equal Tee	VT16
200x200x200mm	Equal Tee	VT20
250x250x250mm	Equal Tee	VT25

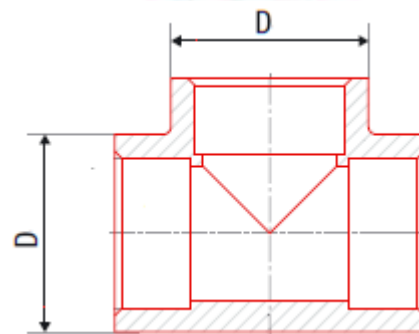

8.) Reducer Socket

Reduces interconnection of individual pipes within a water or heating distribution system, resulting in reduced pressure loss.

Size (D1, D2)	Description	CODE
25/20mm	Reducer Socket	VRS21
32/20mm	Reducer Socket	VRS31
32/25mm	Reducer Socket	VRS32
40/20mm	Reducer Socket	VRS41
40/25mm	Reducer Socket	VRS42
40/32mm	Reducer Socket	VRS43
50/25mm	Reducer Socket	VRS52
50/32mm	Reducer Socket	VRS53
50/40mm	Reducer Socket	VRS54
63/25mm	Reducer Socket	VRS62
63/32mm	Reducer Socket	VRS63
63/40mm	Reducer Socket	VRS64
63/50mm	Reducer Socket	VRS65
75/20mm	Reducer Socket	VRS71
75/25mm	Reducer Socket	VRS72
75/32mm	Reducer Socket	VRS73
75/40mm	Reducer Socket	VRS74
75/50mm	Reducer Socket	VRS75
75/63mm	Reducer Socket	VRS76

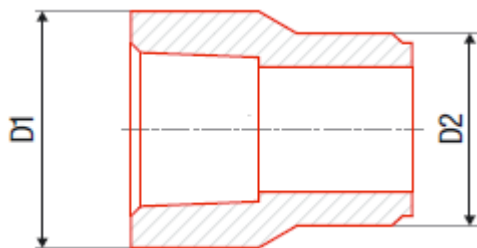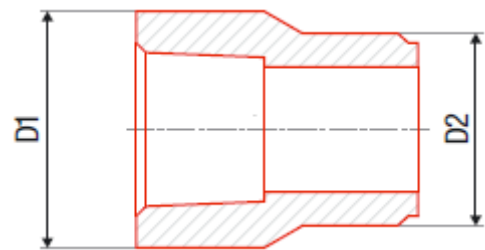

Reducer Socket


Reduces interconnection of individual pipes within a water or heating distribution system, resulting in reduced pressure loss.

Size (D1, D2)	Description	CODE
90/32mm	Reducer Socket	VRS93
90/40mm	Reducer Socket	VRS94
90/50mm	Reducer Socket	VRS96
90/63mm	Reducer Socket	VRS96
90/75mm	Reducer Socket	VRS97
110/40mm	Reducer Socket	VRS104
110/50mm	Reducer Socket	VRS105
110/63mm	Reducer Socket	VRS106
110/75mm	Reducer Socket	VRS107
110/90mm	Reducer Socket	VRS109
160/110mm	Reducer Socket	VRS1610
200/90mm	Reducer Socket	VRS209
200/110mm	Reducer Socket	VRS2010
200/160mm	Reducer Socket	VRS2016
250/160mm	Reducer Socket	VRS2510
250/200mm	Reducer Socket	VRS2520

9.) Elbow 90°


A simple, reliable fitting used to change the direction of a Distribution system. When installed properly it increases the Pressure loss in the distribution system noticeably less than Elbows in other distribution systems. Thanks to the full-size Inside Diameter corresponding to that of the piping.

Size (D)	Description	CODE
20mm	Elbow 90°	VE190
25mm	Elbow 90°	VE290
32mm	Elbow 90°	VE390
40mm	Elbow 90°	VE490
50mm	Elbow 90°	VE590
63mm	Elbow 90°	VE690
75mm	Elbow 90°	VE790
90mm	Elbow 90°	VE990
110mm	Elbow 90°	VE1090
160mm	Elbow 90°	VE1690
200mm	Elbow 90°	VE2090
250mm	Elbow 90°	VE2590

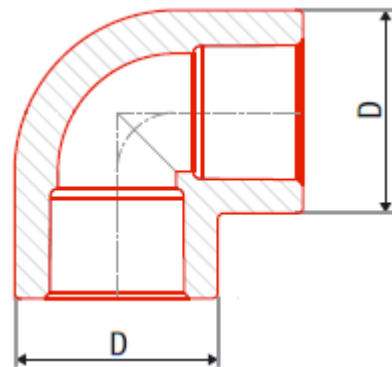

10.) Elbow 45°

A simple, reliable fitting used to change the direction of a Distribution System. When installed properly, it increases the pressure loss in the distribution system noticeably less than elbows in other distribution systems, thanks to the full-size inside diameter corresponding to that of the piping.


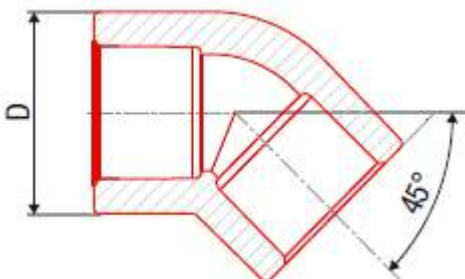


Size (D)	Description	CODE
20mm	Elbow 45°	VE145
25mm	Elbow 45°	VE245
32mm	Elbow 45°	VE345
40mm	Elbow 45°	VE445
50mm	Elbow 45°	VE545
63mm	Elbow 45°	VE645
75mm	Elbow 45°	VE745
90mm	Elbow 45°	VE945
110mm	Elbow 45°	VE1045
160mm	Elbow 45°	VE1645
200mm	Elbow 45°	VE2045
250mm	Elbow 45°	VE2545

11.) Reducer Tee

A fitting allowing for the branching of a distribution system. The inside diameter of the fitting is not reduced compared to the inside diameter of the piping, and therefore, the fitting does not significantly increase the pressure loss in the distribution system.

Size (D1, D2)	Description	CODE
25x20x25mm	Reducer Tee	VRT212
32x25x32mm	Reducer Tee	VRT323
32x20x32mm	Reducer Tee	VRT313
40x20x40mm	Reducer Tee	VRT414
40x25x40mm	Reducer Tee	VRT424
40x32x40mm	Reducer Tee	VRT434
50x20x50mm	Reducer Tee	VRT515
50x25x50mm	Reducer Tee	VRT525
50x32x50mm	Reducer Tee	VRT535
50x40x50mm	Reducer Tee	VRT545
63x25x63mm	Reducer Tee	VRT626
63x32x63mm	Reducer Tee	VRT636
63x40x63mm	Reducer Tee	VRT646
63x50x63mm	Reducer Tee	VRT656
75x25x75mm	Reducer Tee	VRT727

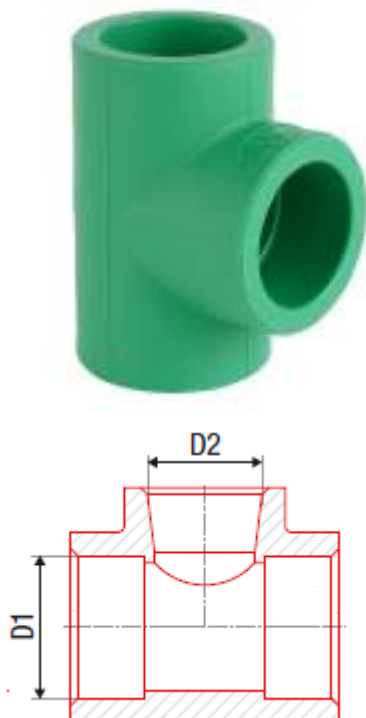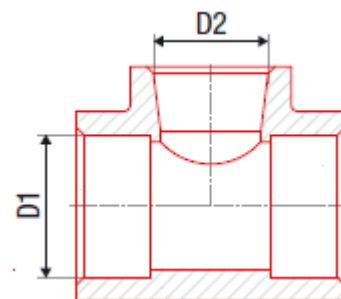


Reducer Tee

Size (D1, D2)	Description	Art. No.
75x32x75mm	Reducer Tee	VRT737
75x40x75mm	Reducer Tee	VRT747
75x50x75mm	Reducer Tee	VRT757
75x63x75mm	Reducer Tee	VRT767
90x40x90mm	Reducer Tee	VRT949
90x50x90mm	Reducer Tee	VRT959
90x63x90mm	Reducer Tee	VRT969
90x75x90mm	Reducer Tee	VRT979
110x40x110mm	Reducer Tee	VRT10410
110x50x110mm	Reducer Tee	VRT10510
110x63x110mm	Reducer Tee	VRT10610
110x75x110mm	Reducer Tee	VRT10710
110x90x110mm	Reducer Tee	VRT10910
160x110x160mm	Reducer Tee	VRT161016

12.) End cap

A permanent or temporary end of a branch of a water or heating Distribution system. Fully corresponding to the pressure range.

Size (D)	Description	CODE
20mm	End Cap	VEC1
25mm	End Cap	VEC2
32mm	End Cap	VEC3
40mm	End Cap	VEC4
50mm	End Cap	VEC5
63mm	End Cap	VEC6
75mm	End Cap	VEC7
90mm	End Cap	VEC9
110mm	End Cap	VEC10
160mm	End Cap	VEC16
200mm	End Cap	VEC20
250mm	End Cap	VEC25



13.) Pipe Bridge


Allows for crossing of individual tracks of a water and Heating Distribution system. It is most often used for distribution systems in Floor or when avoiding vertical pipes.

Size (D)	Description	CODE
20mm	Pipe Bridge	VB1
25mm	Pipe Bridge	VB2
32mm	Pipe Bridge	VB3

14.) Female Adaptor(NON – HEXAGONAL)

A fitting used for the transition from a welded part a water or Heating distribution system to brass screw joints and threaded Fittings.

Size (D)	Description	CODE
20x 1/2"	Female Adaptor	VFA10
25x 1/2"	Female Adaptor	VFA20
25x 3/4"	Female Adaptor	VFA21
32X 1/2"	Female Adaptor	VFA30
32X 3/4"	Female Adaptor	VFA31

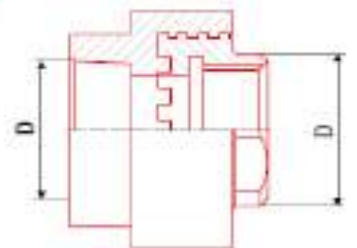



15.) Female Adaptor(HEXAGONAL)


A fitting used for the transition from a welded part of a water or heating distribution system to brass screw joints and Threaded Fittings.

Size (D)	Description	CODE
32x 1"	Female Adaptor	VFA32
40x 1 ¼"	Female Adaptor	VFA43
50x 1 ½"	Female Adaptor	VFA54
63x 2"	Female Adaptor	VFA65
75x 2 ½"	Female Adaptor	VFA76
90x 3"	Female Adaptor	VFA97
110x 4"	Female Adaptor	VFA108

16.) Female Elbow 90°

A fitting used for the transition from a welded part of a water or heating distribution system to brass screw joints and threaded fittings.


Size (D)	Description	CODE
20x ½"	Female Elbow	VFE10
25x ½"	Female Elbow	VFE20
25x ¾"	Female Elbow	VFE21
32x ½"	Female Elbow	VFE30
32x ¾"	Female Elbow	VFE31
32x 1"	Female Elbow	VFE32

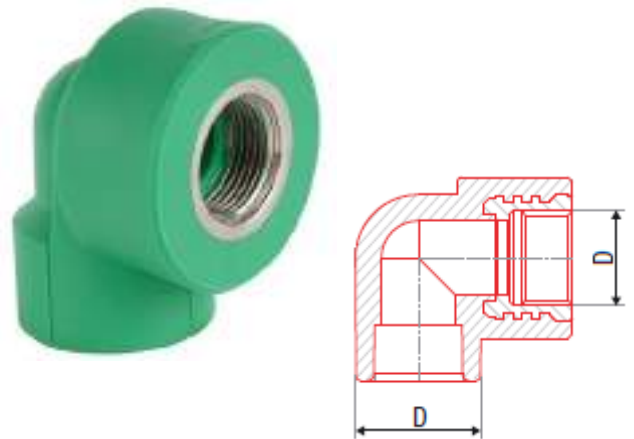

17.) Male Adaptor(NON – HEXAGONAL)

A fitting used for the transition from a welded part of a water or heating distribution system to brass screw joints and Threaded Fittings.



Size (D)	Description	CODE
20x ½"	Male Adaptor	VMA10
25x ½"	Male Adaptor	VMA20
25x ¾"	Male Adaptor	VMA21
32x ½"	Male Adaptor	VMA30
32x ¾"	Male Adaptor	VMA31

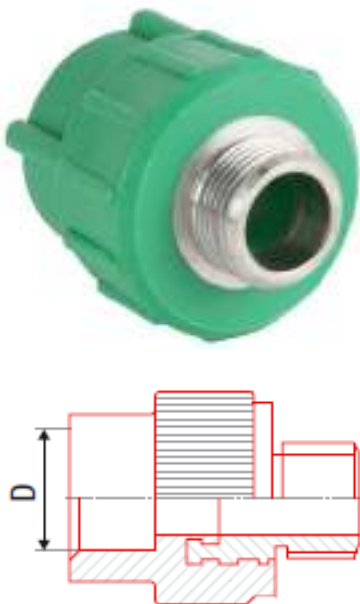

18.) Male Adaptor (HEXAGONAL)

A fitting used for the transition from a welded part a water or Heating distribution system to brass screw joints and threaded Fittings.

Size (D)	Description	CODE
32x 1"	Male Adaptor	VMA32
40x 1 ¼"	Male Adaptor	VMA43
50x 1 ½"	Male Adaptor	VMA54
63x 2"	Male Adaptor	VMA65
75x 2 ½"	Male Adaptor	VMA76
90x 3"	Male Adaptor	VMA97
110x 4"	Male Adaptor	VMA108

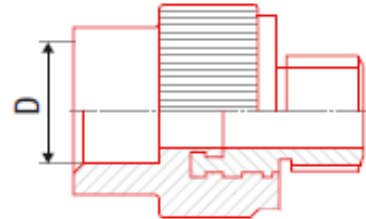

19.) Female Tee


A fitting used for the transition from a welded part of a water or Heating distribution system to brass screw joints and threaded Fittings.


Size (D)	Description	CODE
20x ½"x20	Female Tee	VFT10
25x ½"x25	Female Tee	VFT20
25x ¾"x25	Female Tee	VFT21
32x ½"x32	Female Tee	VFT30
32x ¾"x32	Female Tee	VFT31
32x1"x32	Female Tee	VFT32

20.) Female Union

A fitting used for the transition from a welded part of a water or Heating distribution system to brass screw joints and threaded fittings.

Size (D)	Description	CODE
25x ¾"	Female Union	VFU25
32x1"	Female Union	VFU32
40x1¼"	Female Union	VFU43
50x 1½"	Female Union	VFU54
63x2"	Female Union	VFU65

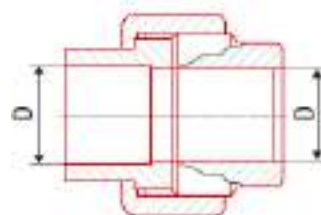

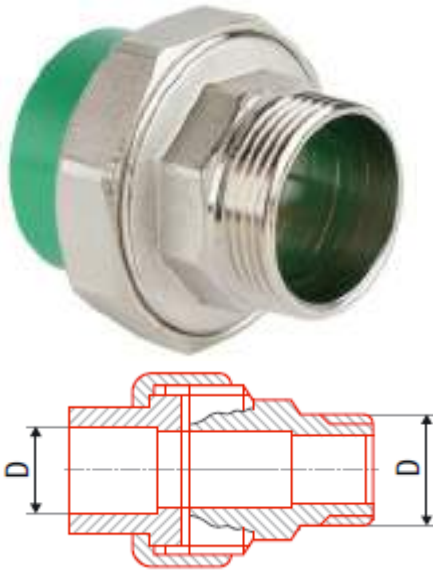

21.) Male Union

A fitting used for transition from a welded part of a water or Heating distribution system to brass screw joints and threaded fittings.


Size (D)	Description	CODE
20x ½"	Male Union	VMU10
25x ¾"	Male Union	VMU21
32x1"	Male Union	VMU32
40x1¼"	Male Union	VMU43
50x 1½"	Male Union	VMU54
63x2"	Male Union	VMU65
75x2 ½"	Male Union	VMU76

22.) Union Socket – Metal

A fitting used for the transition from a welded part of a water or Heating distribution system to brass screw joints and threaded fittings.




Size (D)	Description	CODE
20mm	Union Socket	VUS20
25mm	Union Socket	VUS25
32mm	Union Socket	VUS32
40mm	Union Socket	VUS40M
50mm	Union Socket	VUS50M
63mm	Union Socket	VUS63M
75mm	Union Socket	VUS75M

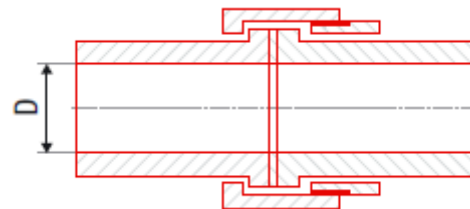

23.) Stainless Steel Non-Rising Stem Valve

Our straight-way plastic valve not only allows for the closure of a distribution system but also enables partial flow regulation in specific sections. With proper operation and maintenance, the replacement parts ensure an almost endless service life.


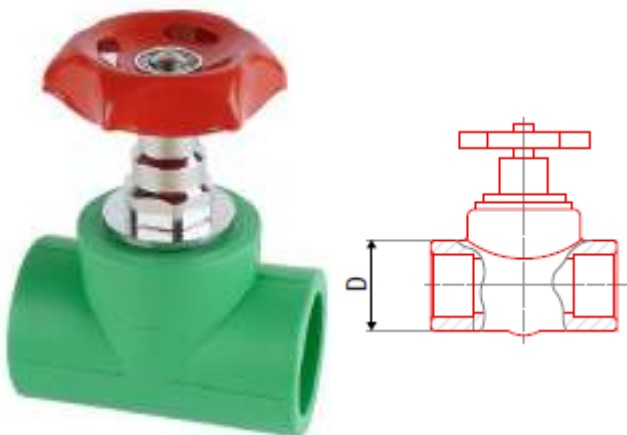


Size (D)	Description	CODE
20mm	S.S Non-Rising Stem Valve	VSSV1
25mm	S.S Non-Rising Stem Valve	VSSV2
32mm	S.S Non-Rising Stem Valve	VSSV3
40mm	S.S Non-Rising Stem Valve	VSSV4
50mm	S.S Non-Rising Stem Valve	VSSV5
63mm	S.S Non-Rising Stem Valve	VSSV6

24.) Chrome Plated Valve

An elegant concealed valve for closing branches of a Distribution System, intended for premises with higher aesthetic requirements Such as bathrooms, toilet rooms and wash rooms.

Size (D)	Description	CODE
20mm	Chrome Plated Valve	VCV1
25mm	Chrome Plated Valve	VCV2
32mm	Chrome Plated Valve	VCV3

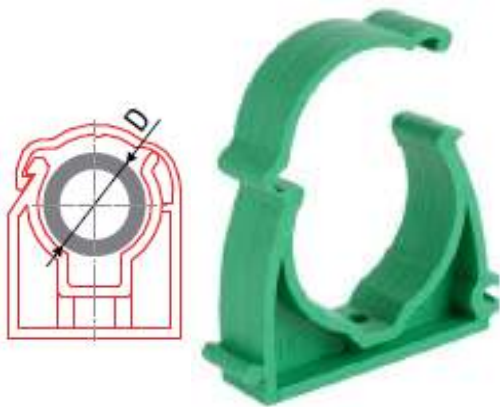

25.) Pipe Clamp


PP-Rc system accessory for fastening pipes.

Size (D)	Description	CODE
20mm	Pipe Clamp	VPC1
25mm	Pipe Clamp	VPC2
32mm	Pipe Clamp	VPC3
40mm	Pipe Clamp	VPC4

26.) Test Plug


Temporary closure of threaded fittings in water or heating Distribution systems. It is used especially for blank wall-Mounted Tee fittings.

Size (D)	Description	CODE
½"	Test Plug	VPTPO



27.) Flange set

A fitting and steel flange used for the transition from a welded part of a water or heating distribution system to flange or mountable joints.

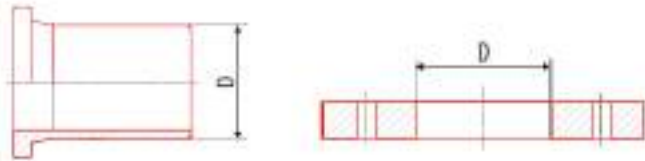

Size (D)	Description	CODE
63mm	Flange Set	VFL6
75mm	Flange Set	VFL7
90mm	Flange Set	VFL9
110mm	Flange Set	VFL10
160mm	Flange Set	VFL16
200mm	Flange Set	VFL20
250mm	Flange Set	VFL25

28.) Welding Socket

To connect pipes to valves, fittings, or other pipe sections, it is recommended to use fillet-type seal welds. Socket welded joints construction is an excellent choice, especially when high leakage integrity and exceptional structural strength are critical design considerations.

Size	Description	CODE
20mm	Welding Socket	VWS1
25mm	Welding Socket	VWS2
32mm	Welding Socket	VWS3
40mm	Welding Socket	VWS4
50mm	Welding Socket	VWS5
63mm	Welding Socket	VWS6
75mm	Welding Socket	VWS7
90mm	Welding Socket	VWS9
110mm	Welding Socket	VWS10



29.) Pipe Cuter

A pipe cutter is a type of tool used by plumber to cut pipes. besides producing a clean cut, the tool is often a faster, cleaner, and more convenient way of cutting pipe



Size	Description	CODE
16-40 mm	Pipe Cuter	PC
16-160mm	PPR Cutter	VPC160
50-160mm	Special Pipe Cuter	SPC



30.) Welding Machine Set

Our PP-Rc Pipe Welding Machine is designed for welding PP-Rc pipes and fittings. It features a high-quality PTFE non-stick coating, ensuring smooth and efficient welding operations.




Size	Description	CODE
20-32 mm	Welding Machine	VWMB
40-110mm	Welding Machine	VSWM

31.) Adjustable Welding Machine Set

Our PP-Rc Pipe Welding Machine is specifically designed for welding PP-Rc pipes and fittings. It is equipped with a high-quality PTFE non-stick coating, ensuring smooth and efficient welding operations.



Size	Description	Art. No.
110-200mm	Welding Machine	VBSWM





VIALLI GERMANY 
GmbH

Terminalstrasse Mittle 18, Munich, Bayern, 85356 Germany
Email: info@vialligmbh.de
Tel: +49 173 4674615



www.vialligmbh.de